

GRIDLINK INTERCONNECTOR NON-TECHNICAL SUMMARY

*under Article 9(7) of EU Regulation No. 347/2013 on guidelines for
trans-European energy infrastructure
(TEN-E Regulation)*

prepared by

GridLink Interconnector Ltd

August 2020

Rev. 2



**Co-financed by the Connecting Europe
Facility of the European Union**


CONTENTS LIST

1. INTRODUCTION.....	3
1.1 THE PROJECT.....	3
1.2 PROJECT PROMOTER.....	3
1.3 PROJECT OF COMMON INTEREST (PCI).....	4
1.4 PROJECT TIMETABLE.....	4
1.5 PROJECT STATUS AND UPDATES	5
2. OBJECTIVES OF THE PROJECT	6
3. PROJECT HISTORY.....	8
4. PROJECT DESCRIPTION.....	12
4.1 SUBSEA CABLE ROUTE.....	12
4.2 ONSHORE CABLE ROUTE AND CONVERTER STATION SITE IN FRANCE.....	15
4.3 ONSHORE CABLE ROUTE AND CONVERTER STATION SITE IN UK.....	16
4.4 SUBSEA CABLE INSTALLATION.....	17
4.5 UNDERGROUND CABLES AND CONVERTER STATION IN FRANCE	20
4.6 UNDERGROUND CABLE AND CONVERTER STATION IN UK.....	27
5. ENVIRONMENTAL IMPACTS.....	32
5.1 POTENTIAL ENVIRONMENTAL IMPACTS.....	32
5.2 PROTECTED ENVIRONMENTAL SITES.....	34
6. ENVIRONMENTAL IMPACT ASSESSMENT.....	37
6.1 EIA PROCEDURES IN FRANCE.....	37
6.2 EIA PROCEDURES IN UK.....	38
7. PUBLIC CONSULTATIONS.....	40
7.1 PUBLIC CONSULTATIONS IN FRANCE.....	40
7.2 PUBLIC CONSULTATIONS IN UK.....	41
7.3 WEB-SITE.....	42
7.4 CONCEPT FOR PUBLIC PARTICIPATION.....	43
8. FURTHER INFORMATION.....	44

The GridLink Interconnector Project

GridLink interconnector is an electrical interconnection project between France and the United Kingdom:

- Nominal capacity of 1.4 GW, which corresponds to the electricity supply for 2.2 million homes
- 140 km of submarine interconnector cable – 108 km in UK territorial waters and 32 km in French territorial waters
- 13.5 km of underground interconnector cable in France
- Converter stations in France and UK
- 3 km of underground cable in France and 1.5 km of underground cable in the UK to connect the converter stations to the national grids in each country
- Estimated investment of approximately 900 million euros

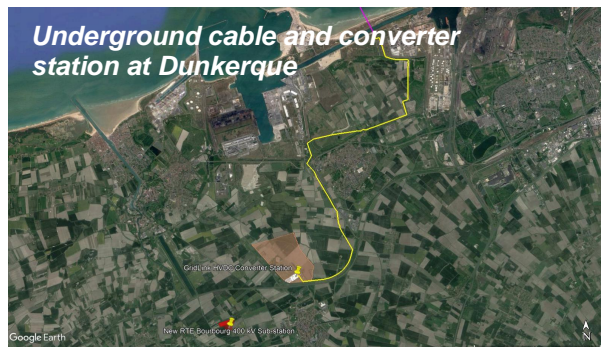

1. INTRODUCTION

1.1 THE PROJECT


The GridLink project is a new interconnector of 1,400 megawatts and a voltage of approximately 525 kV (direct current).

The project comprises five principle elements:

1. Subsea high voltage direct current cable;
2. Underground cables from the shoreline to the converter stations in the UK and France;
3. Converter stations in UK and France;
4. Underground high voltage alternating current cable from the converter stations to the existing 400 kV network in UK and France;
5. New sub-station next to the Warande sub-station in France (there is no extension required at Kingsnorth sub-station in UK).

The GridLink scheme is illustrated in **Figure 1** below.

Figure 1 Schematic of the GridLink Project

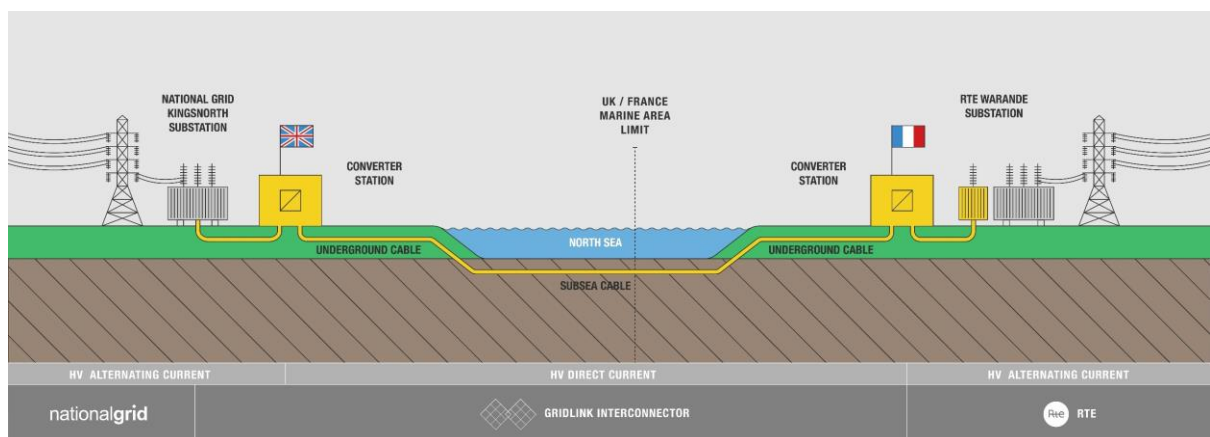

1.2 PROJECT PROMOTER

GridLink Interconnector Limited was established for the purpose of developing, building and operating the GridLink Interconnector project, and it is the owner and principal developer of the project.



The parent company that 100% wholly-owns GridLink Interconnector Ltd is iCON Infrastructure Partners III. iCON is an independent fund for investment in infrastructure projects. iCON administers investments and participations on behalf of globally recognized pension funds, insurance companies and asset managers. Currently, iCON administers investment capital of 2.5 billion euros.

1.3 PROJECT OF COMMON INTEREST (PCI)

GridLink has been awarded the status of Project of Common Interest (PCI) by the European Commission.


The award of PCI status was confirmed by the publication of Commission Delegated Regulation No. 2018/540 of 23 November 2017 amending Regulation (EU) No 347/2013 of the European Parliament and of the Council as regards the Union list of projects of common interest in the Official Journal on 6th April 2018.

1.4 PROJECT TIMETABLE

The indicative implementation timetable for GridLink is given in **Figure 2**.

The timetable depends upon a number of parallel activities, including regulatory approvals in UK and France for cross border cost allocation/regulatory regime, offshore and onshore cable route and site surveys, development consents and permits, Engineering, Procurement and Construction (EPC) contract procurement and project financing for the construction costs. The durations of several activities are also dependent on the deliberations of national regulatory authorities and competent authorities, and if any public comments or responses are received via statutory public consultations. Therefore, the start dates, durations and sequence of activities are indicative only and may be amended.

Figure 2 Indicative Implementation Timetable for the GridLink Project

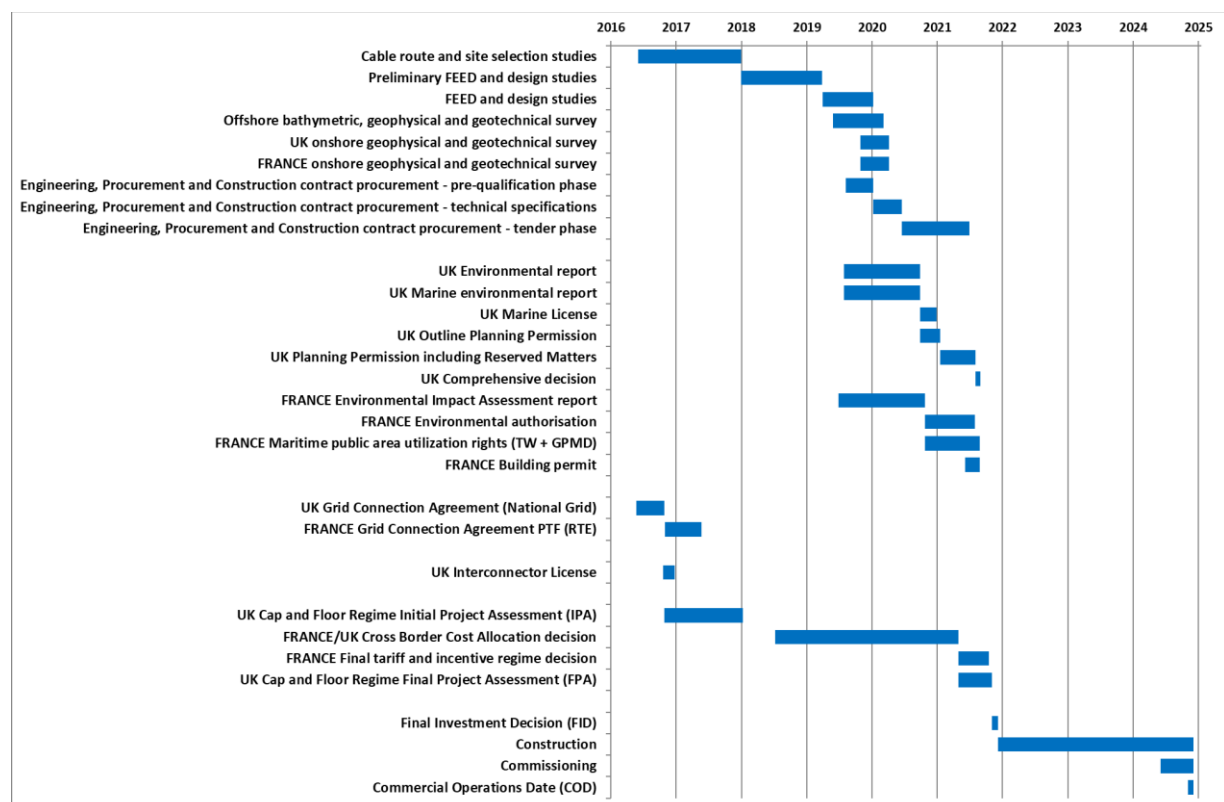

The key dates of the implementation timetable are:

- September 2020 Applications for development consents and permits in UK
- November 2020 Applications for development consents and permits in France
- December 2020 Marine License granted (UK)
- January 2021 Outline Planning Permission granted (UK)
- July 2021 Engineering, Procurement and Construction contracts awarded for HVDC cable system and converter stations
- August 2021 Environmental authorisation granted (France)
- September 2021 Maritime public area utilization rights granted (France)
Building permit granted (France)
Reserved matters of Outline Planning Permission completed (UK)
Comprehensive decision on permit granting (UK and France)
- November 2021 Approval of regulatory scheme by national regulatory authorities (UK and France)
- December 2021 Final Investment Decision
Start of construction
- June 2024 Commissioning
- December 2024 Commercial Operations Date

The construction period is 3 years from the dated of the Financial Investment Decision.

The operational lifetime of the GridLink project is at least 25 years. Typically, a submarine interconnector can operate commercially for over 45 years.

1.5 PROJECT STATUS AND UPDATES

The Non Technical Summary is updated to reflect the current status of the GridLink project.

The updates made to the Non Technical Summary at each revision are summarised in **Table 1**.

Table 1 Updates made to the Non Technical Summary

Revision No.	Date	Status	Changes made to previous version
1	June 2020	First version approved by Marine Management Organisation	-
2	August 2020	Second version	Minor amendments to description of onshore cable route in Dunkerque, public consultations and web-site

2. OBJECTIVES OF THE PROJECT

The European energy market faces many challenges linked to aging infrastructure, environmental targets and energy transition. Meeting these challenges requires a significant shift towards a greater share of renewable energy supported by an improved transmission network capable of distributing energy and ensuring the security of supply.

GridLink's objective is to be a part of these transformations by improving the capacity of French and UK networks to distribute electricity to consumers, and to ensure that electricity supply is secure in the event of production uncertainty linked to renewable sources, availability of existing generation units, transmission network or other reasons.

The economic benefits of GridLink will include increasing competitiveness in the energy market, by offering import and export trade between France and the UK. According to demand, which changes depending on the time of day, season, weather conditions, and availability of renewable energy, GridLink will be able to either import or export electricity. This opens up commercial opportunities for energy producers, thus reducing costs for consumers.


GridLink also guarantees advantages for the French and UK national networks:

- Improvement of network stability;
- Extension and diversification of capacities;
- Limitation of cost management constraints;
- Improvement of upgrading capacity;
- Increasing renewable energy integration under secure conditions.

GridLink's main objective is for the French and UK national network—energy producers and consumers—to benefit from these advantages through the most viable, efficient, and environmentally-friendly project possible.

The marine electricity interconnectors between the northern European States are identified in the priority corridors of the European Union, as shown in **Figure 2**. These zones have been identified to promote the integration of energy markets in Europe and the diversification of energy sources and transport routes, with the objective of competitiveness, sustainability and security of supply.

Figure 2 Priority Corridors for Electricity Networks
(source: European Commission)

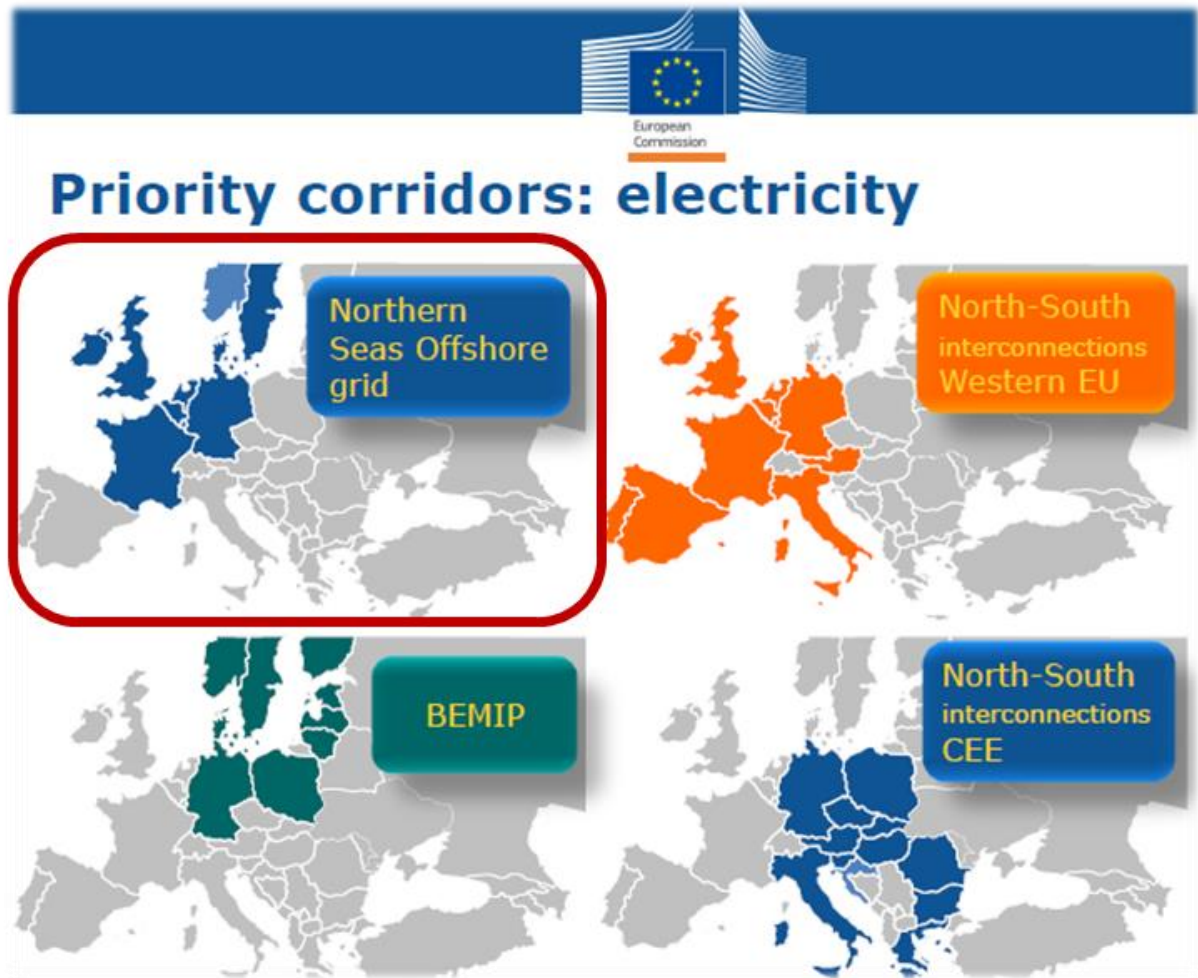

3. PROJECT HISTORY

The development of the GridLink project began in early 2015.

The first step was to designate France and the UK as the optimal connection market for a new cross-border electricity interconnector. This decision was based on the significant advantages of the interconnector in terms of:

- Security of energy supply;
- Transporting electricity produced by renewable energy;
- Electricity price differentials, which persist over time and guarantee the commercial viability of such a project.

Network availability for the import and export of electricity between France and the UK was established by a study of network constraints, and initial consultations, with national transmission operators: Réseau de Transport d'Electricité (RTE) for France and National Grid Electricity Transmission (NGET) for the UK. As a result of these studies, more than 20 potential routes have been identified from existing high voltage 400 kV substations on the coast of the UK to similar facilities on the French coast.

In May 2015, GridLink asked RTE to conduct a prospective study about the potential points of connection to the 400 kV network in northern France. In accordance with the procedure for processing applications for connection of new interconnectors to the public electricity transport network, RTE then offered GridLink a list of the substations to which the interconnector could be connected which were evaluated according to the following criteria:

- a) Technical feasibility of connecting to the substation;
- b) Qualitative assessment of the risk of constraints on the network and the need for reinforcements.

This study resulted in Warande (Bourbourg commune, Nord department) being chosen as the preferred connection site. Other possible connection sites were discounted because of insufficient capacity. The constraints on the electricity transport system in these areas meant significant strengthening work on the RTE network (new overhead transmission lines, new sub-stations, etc) may have been needed posing technical difficulties. From a technical perspective, the feasibility of connecting the GridLink project to the French network was confirmed by exploratory studies carried out by RTE up until October 2016.

Subsequently, the technical and financial proposal (PTF) concerning the work required to create the connection was developed and signed in May 2017 by RTE and GridLink Interconnector Ltd.

Figure 3 shows the various points considered during the prospective study, which concluded that Warande was the preferred connection site.

Figure 3 Points Studied for Connection to the French Electricity Grid




In the UK, GridLink also studied the possibility of connecting to the 400 kV network along the south coast of England. Preliminary feasibility studies indicated that the electricity generated by the new interconnector could not be transported to/from anywhere on the network along the south coast due to the limited capacity of existing transport links and current and future electricity production.

Based on this analysis, the preferred area with the fewest constraints is located along the Thames estuary near London. Seven potential connection points were then shortlisted: Cleve Hill, Coryton, Grain, Kemsley, Kingsnorth, Northfleet East and Rayleigh Main. Further assessments, particularly taking into account technical and economic considerations, identified the Kingsnorth sub-station as

the preferred connection site. Subsequently, a grid connection agreement concerning the connection at the Kingsnorth sub-station was developed and signed in October 2016 by National Grid and GridLink Interconnector Ltd.

Figure 4 shows the various points considered during the study, which concluded that Kingsnorth was the preferred connection site.

Figure 4 Points Studied for Connection to the UK Electricity Grid

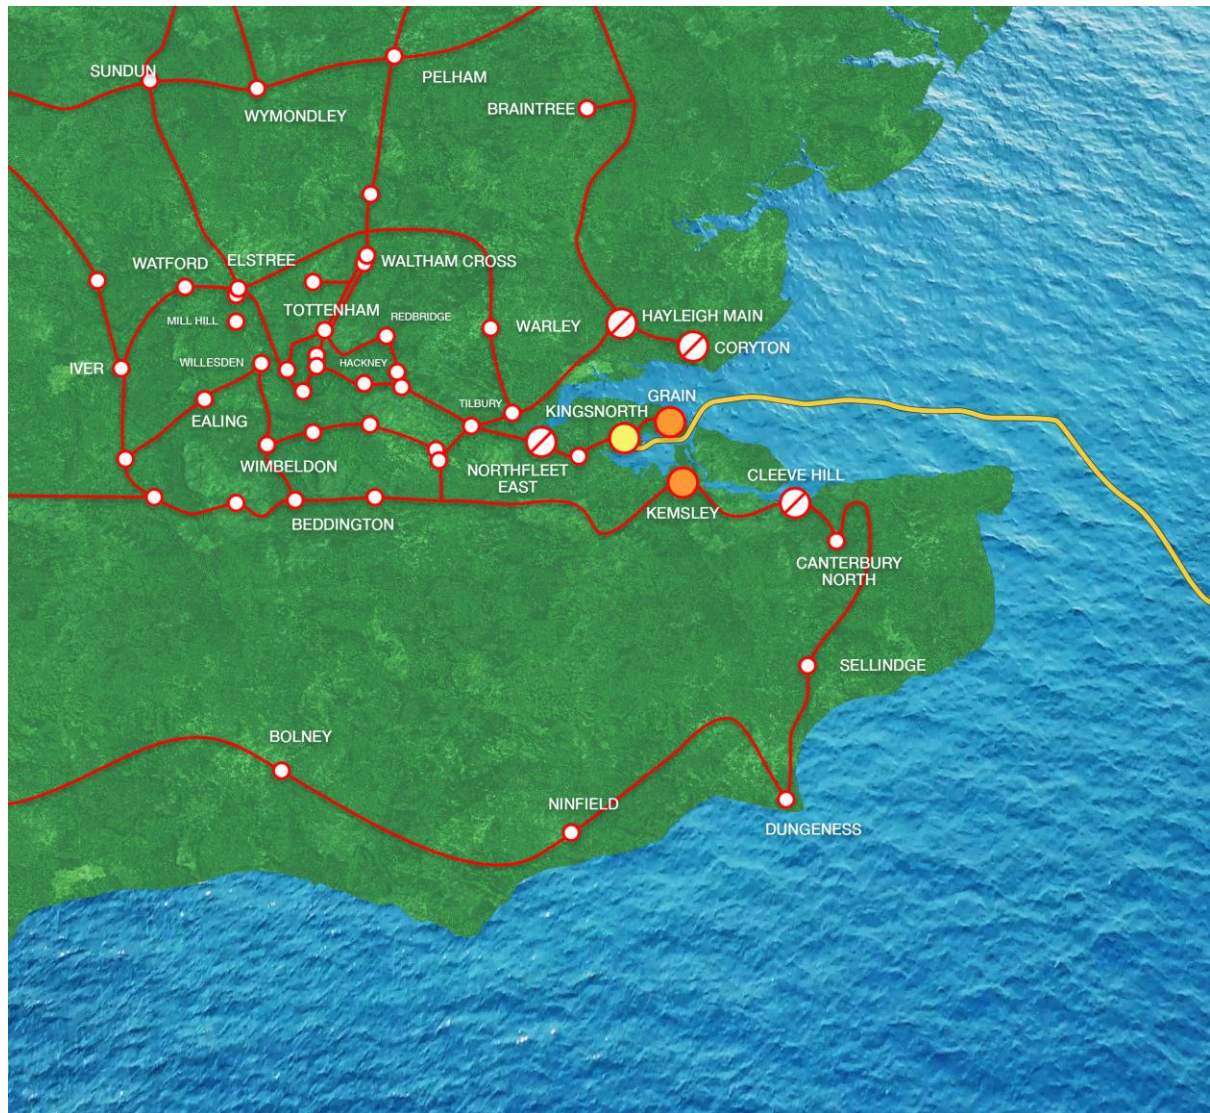

After these connection sites in France and the United Kingdom had been chosen, technical and environmental feasibility studies were carried out in 2016, in order to establish the precise location of the route and the converter stations at each end for transforming direct current to alternating current.

The project has now entered its development phase, during which detailed technical studies are carried out together with environmental impact assessments in France and in UK. The project will be optimised and modified based on:

- Geological surveys of the seabed and land to be crossed by the cable route;
- Technical studies carried out at sea, on land and on the coast;
- Environmental studies;
- Public consultations.

The objective of this phase is to put forward a project that avoids and minimises environmental impacts, whilst taking into account the opinions and interests of the public and local stakeholders.


4. PROJECT DESCRIPTION

4.1 SUBSEA CABLE ROUTE

The subsea cable route will be approximately 140 km long, with 32 km in French territorial waters and 108 km in UK territorial waters.

The cable route is shown in **Figure 5**.

Figure 5 GridLink Subsea Cable Route

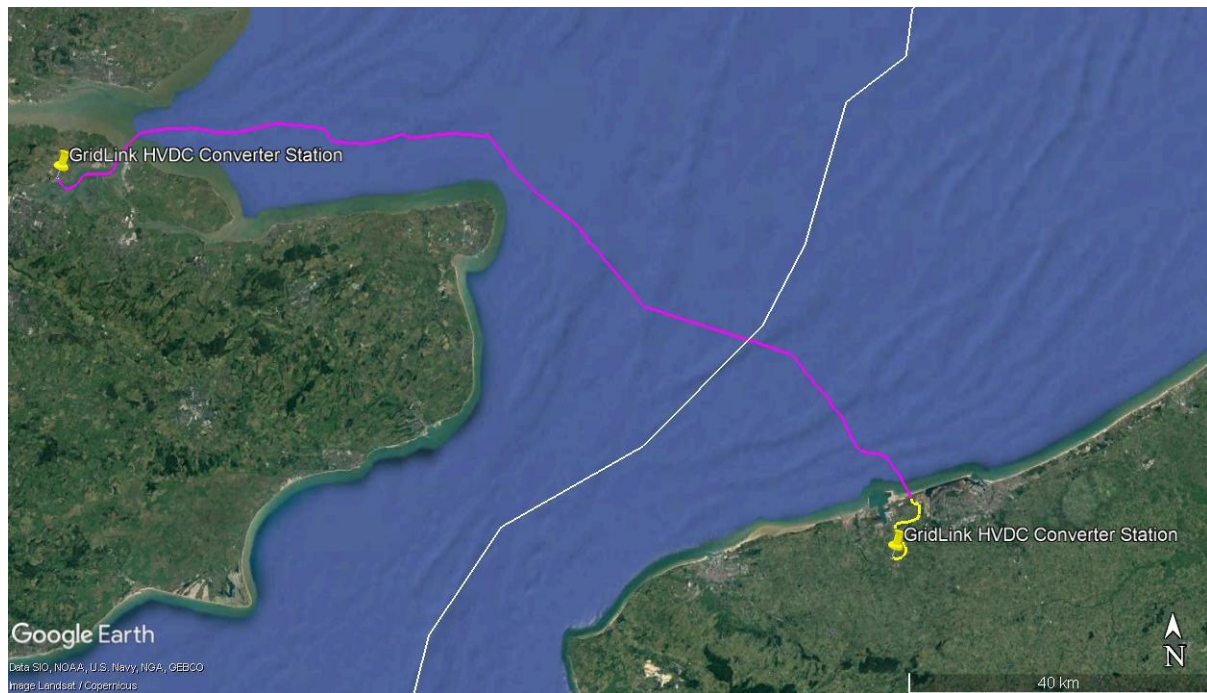

The subsea cable route is the most direct and shortest route that is possible between the required connection points in the UK and France, taking into account the results of extensive studies of the seabed conditions, including:

- Seabed geology, mobility and sedimentation;
- Water depths;
- Navigation channels and anchorages;
- Protected environmental areas at European and national levels;
- Existing and planned cables and pipelines;
- Windfarms and other restricted areas;
- Shipping traffic;
- Fishing;
- Wrecks;
- Other seabed obstacles.

The studies have included desk-top research of published information, bathymetric, geophysical, geotechnical and environmental surveys, consultations with navigation authorities (Grand Port Maritime de Dunkerque, Port of London Authority, Peel Ports) and coordination with third party cable owners.

An overview of the marine use areas and marine obstructions determined by the studies is shown in **Figure 6 (UK)** and **Figure 7 (France)** respectively.

Figure 6 Marine Use Areas and Obstructions in UK Waters


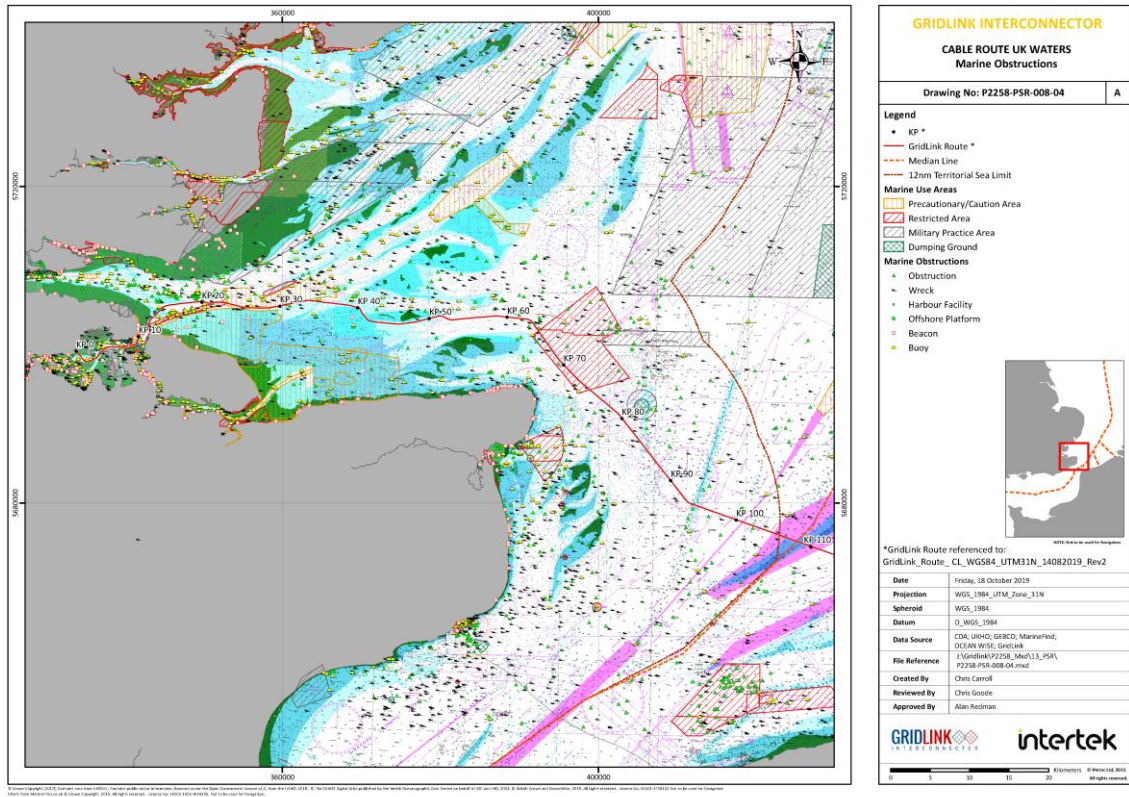


Figure 7 Marine Use Areas and Obstructions in French Waters

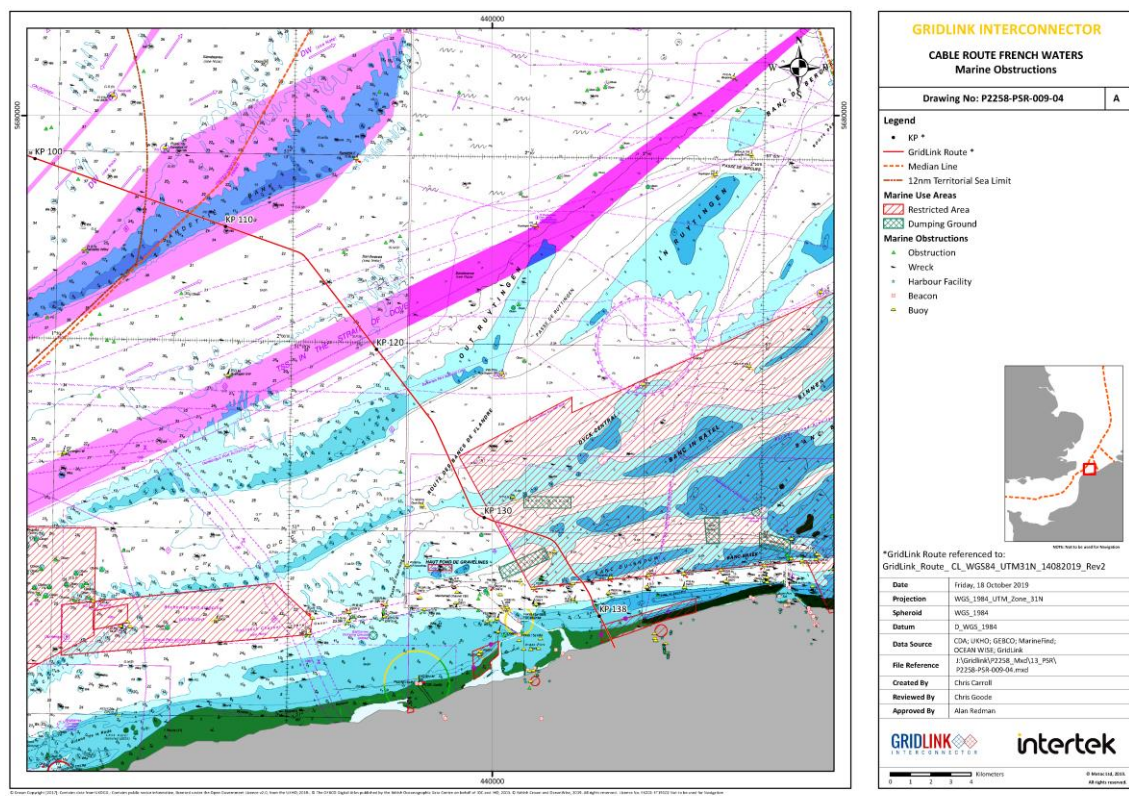

The key advantages of the selected subsea cable route are:

- The cable route is the shortest route that is technically and environmentally feasible, to minimise seabed intervention and disruption to other marine users;
- The length of the cable route crossing designated environmental protected areas is minimised, and the protected features of the designated areas are avoided;
- No anchorages are directly affected by the cable route, and the crossing of navigation channels are as short as possible and perpendicular to shipping traffic flows to minimise disruption;
- The cable route avoids all known wrecks and associated debris fields;
- The crossings of third party cables are designed to minimise effects in the other cables, rock placement and the risk of scour;
- Any known seabed obstacles, including Unexploded Ordnance, are avoided wherever practicable;
- The crossing of areas of high sediment mobility or sand waves are minimised.

The main alternative subsea cable routes that were evaluated as part of the route selection process were:

- a) **Alternative route to the north of the BritNed interconnector cable in the Thames Estuary:** This alternative was discounted because it required two crossings of the BritNed interconnector cable and it would traverse the main shipping channel to the Port of London. The selected subsea cable route is to the south of the BritNed interconnector cable, therefore it does not require any crossings and remains outside of the main shipping channel.
- b) **Alternative route to the north of the Pan Sands sand bank in the Thames Estuary:** This alternative was discounted because the sand bank is migrating northwards, such that the water depth is too shallow for cable installation. The selected subsea cable route is to the south of the Pan Sands sand bank where the water depth is deeper and not expected to change due to sediment mobility.
- c) **Alternative routes around major obstacles, such as wind farms and restricted areas:** These alternatives generally require the cable route to travel further to the east into the southern North Sea before turning south to Dunkerque, therefore they were discounted because they result in a significant increase to the cable route length and associated crossings of environmental areas, shipping channels and other assets.
- d) **Alternative approaches to the Dunkerque shore crossing:** These alternatives were discounted because they require the cable route to approach the shoreline at oblique angles requiring greater disruption to shipping traffic in the navigation channel approaching Dunkerque and/or seabed with high mobility that is more difficult for cable installation.

The selected cable route is designed as an optimal solution that avoids major obstacles and minimises the crossing of designated sensitive navigation, environmental or other areas.

4.2 ONSHORE CABLE ROUTE AND CONVERTER STATION SITE IN FRANCE

In France, the subsea cable will cross the coastline by horizontal direction drilling at the Port of Dunkerque, and from this point an underground cable route of about 13.5 km will cross industrial and agricultural areas owned by the Grand Maritime Port of Dunkerque (GPMD).

The converter station will also be built on land belonging to the GPMD. The converter station will be built in an area identified as an industrial development zone: the heavy industries zone (ZGI).

The converter station is located at a distance of approximately 3 km from the RTE national grid at Warande, which will be reached by an underground HVAC cable from the converter station to a new sub-station to be built next to the existing Warande sub-station (the “new Bourbourg sub-station”).

There are no overhead electricity transmission lines to be constructed in France to implement the GridLink project, although the existing pylons next to the Warande sub-station may need to be reconfigured.

The underground cable route and converter station site are shown in **Figure 8**.

Figure 8 Underground cable route, converter station site and new RTE sub-station in France



The onshore cable route has been defined to fit within the development plans of the GPMD for new industrial developments in the area. The cable route is within an easement corridor assigned by GPMD for the construction of underground public utilities and associated infrastructure.

In addition, the cable route takes into account the results of extensive studies of the existing and future land uses and sensitivities, including:

- Soil geology;
- Protected environmental areas, and the presence of any habitats or species of higher ecological value;
- Watergang network;

- Agricultural production and pedology, including field boundaries, hedges and trees;
- Residential properties;
- Future industrial projects;
- Existing and planned underground public utilities and other cables and pipelines;
- Existing and planned roads, railways and canals;
- Other obstacles.

The studies have included desk-top research of published information, topographical, geophysical, geotechnical and environmental surveys, consultations with land owners (Grand Port Maritime de Dunkerque and tenant farmers) and coordination with the operators of public utilities.

Where the cable route crosses sensitive features, the cable installation is designed to mitigate adverse impacts. In particular, the crossing of protected dunes at the shoreline, main roads, railways, canals and major watergangs will utilise horizontal directional drilling (HDD) under the feature to avoid any disturbance at the surface.

The converter station site comprises a plot of 6.2 ha within the Zone de Grandes Industries (ZGI) that has been designated by GPMD. The converter station will utilise approximately 3.5 ha of the land, with an additional 2.7 ha available as an open area after construction is completed. The location of the converter station site has been selected to provide the optimum connection point to the underground HVDC cable and underground HVAC cable routes.

The 3 km underground HVAC cable and new Bourbourg sub-station (next to the existing Warande sub-station) to provide the connection to the national grid will be implemented by RTE. The selection of the cable route and new sub-station site is carried out by RTE under the terms of the grid connection agreement with GridLink. The consultation procedures to select the cable route and converter station site will be completed in July 2020.

4.3 ONSHORE CABLE ROUTE AND CONVERTER STATION SITE IN UK

In the UK, the submarine cable will cross the coastline by horizontal directional drilling (HDD) at the former E.on coal-fired power station (now demolished) at Kingsnorth on the Isle of Grain, and emerge directly at the converter station site.

The converter station will be built in an area previously used for Heavy Fuel Oil (HFO) storage tanks within the former power station site. Therefore, the site has previous heavy industrial use, and it is within an industrial zone characterised by the former Kingsnorth coal-fired power station (demolished), Damhead Creek natural gas-fired power station, logistics and distribution warehouses and mixed engineering uses.

The converter station is located at a distance of approximately 1.5 km from the National Grid substation in Kingsnorth, which will be reached by an underground HVAC cable from the converter station.

There are no overhead electricity transmission lines to be constructed in the UK to implement the GridLink project.

The onshore HVDC cable route and converter station site are shown in **Figure 9**.

Figure 9 Underground HVDC cable route, converter station site and National Grid Kingsnorth sub-station in UK



The exit of the horizontal directional drilling (HDD) for the submarine cable arrives at the converter station site, therefore there is no onshore cable route.

The converter station site comprises a plot of 4.4 ha within the former Kingsnorth coal-fired power station. The location of the converter site has been selected to provide the optimum alignment with the submarine cable route and shore crossing that also does not restrict the future development of other areas.

The 1.5 km underground HVAC cable route to the National Grid Kingsnorth sub-station takes into account the results of extensive studies of existing and future land uses and sensitivities, including:

- Soil geology;
- Protected environmental areas, and the presence of any habitats or species of higher ecological value;
- Use of the jetty and associated marine operations;
- Future industrial projects;
- Underground obstacles from the demolition of the former power station.

The studies have included desk-top research of published information, topographical, geophysical, geotechnical and environmental surveys and consultations with the landowner (Uniper).


4.4 SUBSEA CABLE INSTALLATION

The subsea cable will consist of two high voltage direct current (HVDC) cables of polyethylene (XLPE) or mass impregnated (MI) construction. The diameter of each cable will be approximately 150 mm, with a central part made of copper. The cables will be protected to prevent damage by an outer

sheath. A smaller fibre-optic cable will be included with the bundled HVDC cables for monitoring and control purposes.

The cables will be buried bundled together in the same trench at a depth of approximately 2 m below the seabed in order to protect the cable. The trench will ensure that the cable will not be exposed by natural events, for example movement of sediments, and human interaction from anchoring of vessels or fishing nets. An illustration of the buried cable is shown in **Figure 10**.


Figure 10 Illustration of the Submarine Cable Trench

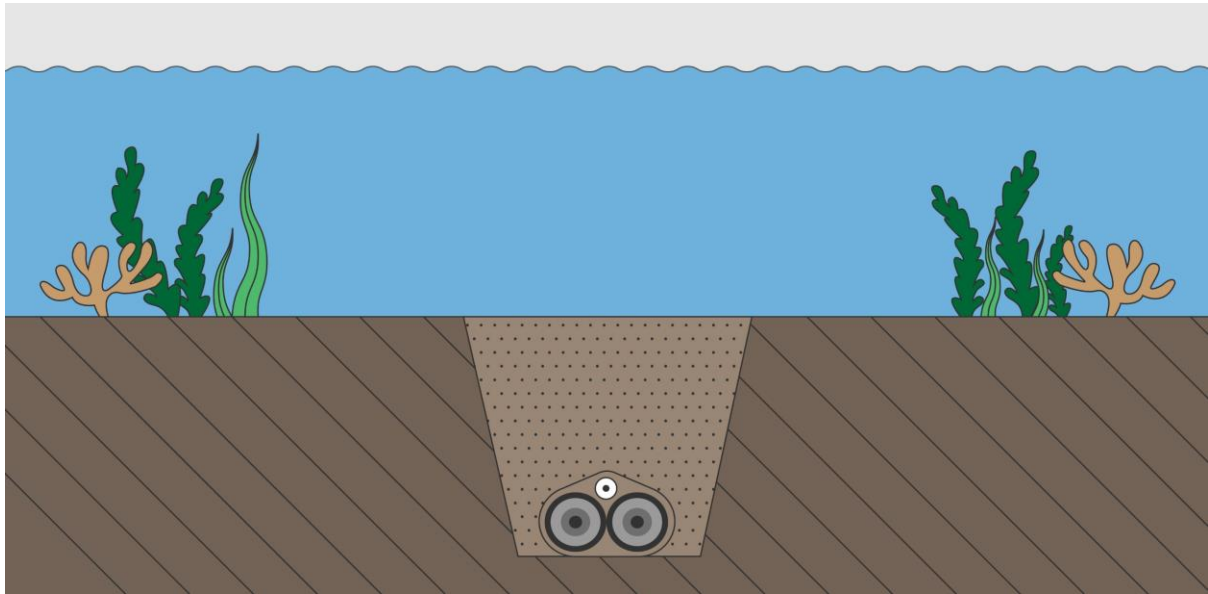

The burial depth to protect the cable may vary along the cable route to take into account different seabed geology, sediment mobility and the risks from ships (anchoring) and fishing (trawling).


In case a geological unit does not allow burial of the cable, the cable will be protected by rock placement. A typical cross-section of the cable covered by rock placement is illustrated in **Figure 11**.

Figure 11 Schematic Cross-section of Rock Placement over the Submarine Cable

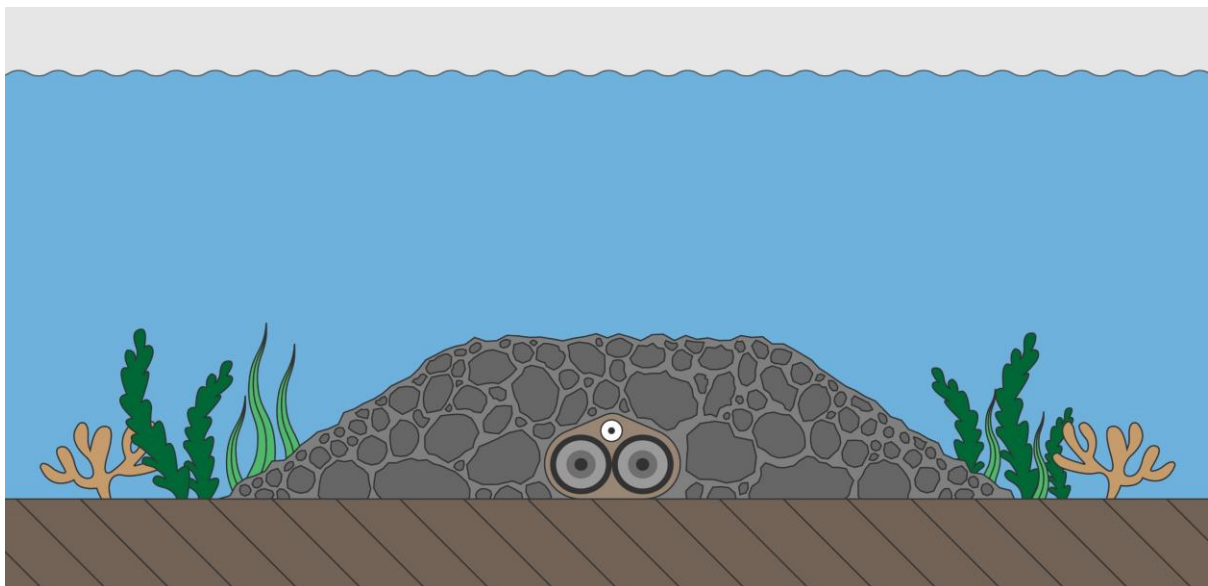

At crossings of existing submarine cables, the existing cables will be protected by a mattress allowing the new cables to pass over the top. The new cables will then be protected by rock placement or similar technique. An illustration of a submarine cable crossing using a mattress is provided in **Figure 12**.

Figure 12 Schematic View of Placement of Concrete Mattresses at Crossing of Third Party Submarine Cable with Protection by Rock Placement

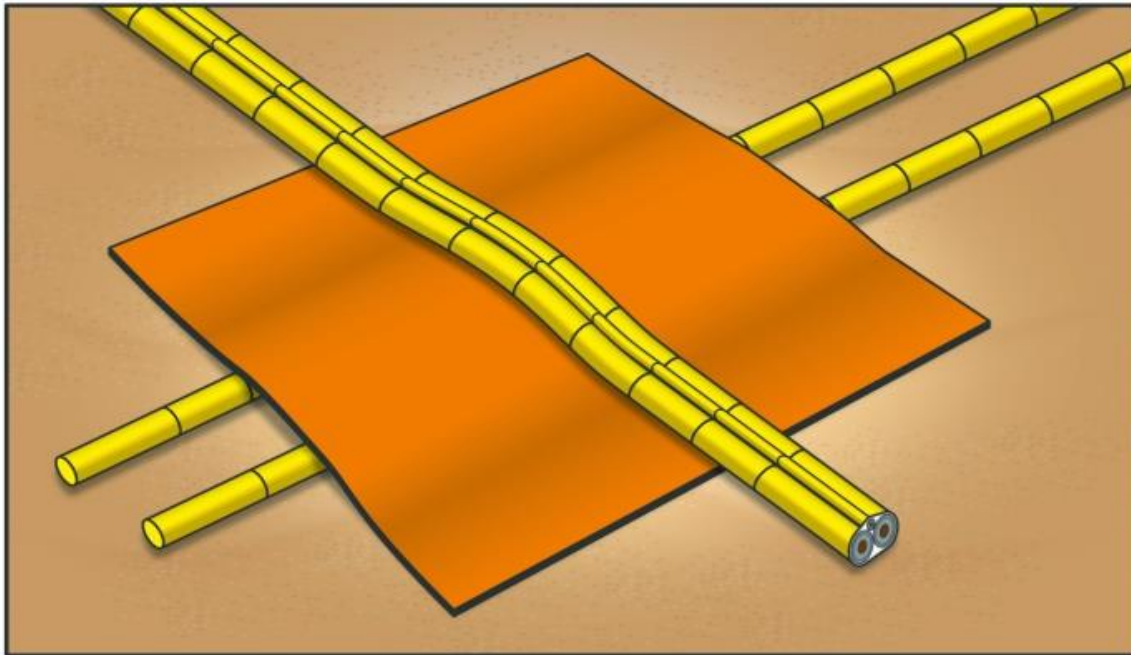

The cable installation techniques, including the methods to be used for trenching, cable installation and backfilling, will be determined after engineering studies have been completed. Different cable installation and burial techniques will be used depending on geology, seabed conditions, water depth and environmental considerations along the cable route.

Depending on the techniques chosen based on the studies, the cable trenching and installation speed can vary from 200 m to 400 m per hour. The work to lay the cable will be carried out 24 hours per day, in order to minimise the impact on navigation and other sea users.

There are a range of different vessels that may be used for the cable installation, depending on the construction contractor selected for the works. In addition to the cable-laying vessels themselves, research, supply and safety vessels will also be required. Other users of the sea will be notified in accordance with the regulatory procedures which apply, and in collaboration with the Préfecture Maritime for the Channel and North Sea and Port of London Authority and Peel Ports for the Thames Estuary, to guarantee safety for navigation and for the cable-laying works.

An example of a typical cable-lay vessel is shown in **Figure 13**.

Figure 13 Typical Vessel used to lay the Subsea Cables
(source: NKT)



4.5 UNDERGROUND CABLES AND CONVERTER STATION IN FRANCE

The coastline at the Port of Dunkerque will be crossed by horizontal directional drilling (HDD). This entails the drilling of two horizontal shafts that traverse below the dunes, ship canal and existing utility infrastructure networks. The cables are then pulled through each shaft. The directional drilling technique ensures that there is no surface disturbance thus avoiding any impact on existing natural habitats or infrastructure.

The drilling will follow an elliptical trajectory at an angle of about 8 to 12°, passing beneath the coastline and emerging after the low water mark. Ducts will then be installed. When the subsea cable arrives, the individual cables will be pulled separately from the sea through the ducts. Once they emerge from the ducts, the cables will be modified to remove the marine protection, thus reducing their size and weight, and increasing their flexibility necessary for the onshore cable installation.

The HDD at the Dunkerque shore crossing is shown in **Figure 14**.

The indicative cross-sectional profile of the HDD is shown in **Figure 15**.

The steps in implementing the HDD are shown in **Figure 16**.

Figure 14 Horizontal Directional Drilling (HDD) at Shore Crossing in Dunkerque



Figure 15 Schematic Cross-section of the Shore Crossing by Horizontal Directional Drilling (not to scale)


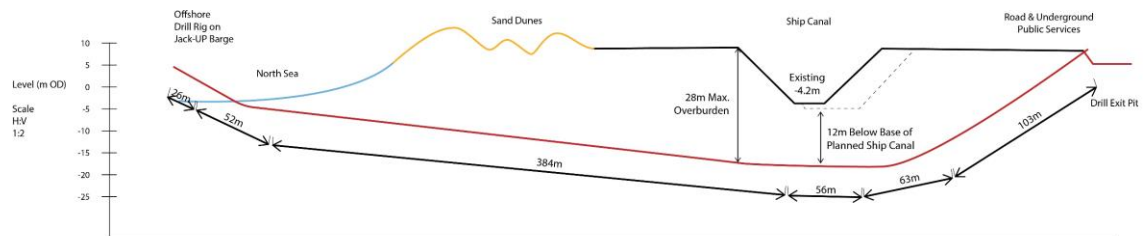


Figure 16 Steps in the implementation of Horizontal Directional Drilling

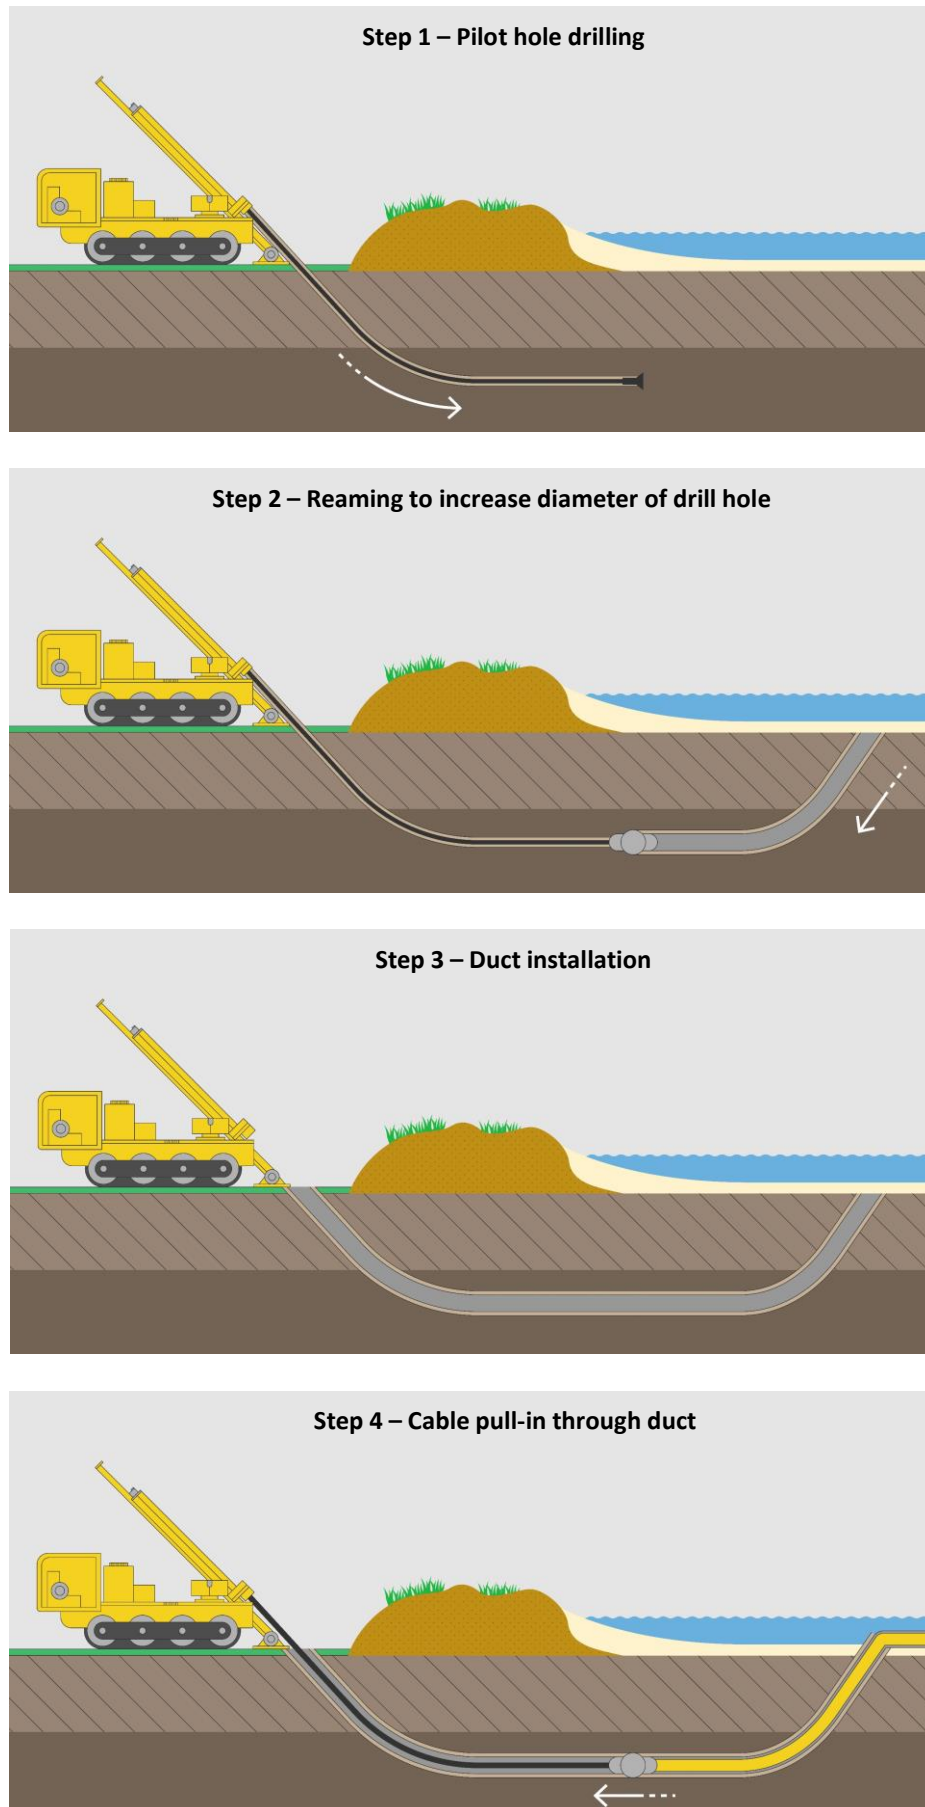


The terrestrial cables will be installed underground, using a trenching technique, in agricultural land. Cables will then be combined in a single trench at 1.0-1.5 m deep in the natural ground. Any vegetation present will be removed before the trench is excavated. The trench will be dug using mechanical excavators, except where there is a risk to the public network systems or where there are environmental constraints, in which case manual excavation methods will be used. The excavated material will be stored temporarily before reuse as backfill.

Where the onshore cable route crosses major roads, railways and large water drainage ditches, horizontal directional drilling will be used to pass underneath the infrastructure without disturbing the surface. The methodology to implement the crossings will be similar to the shore crossing.

The indicative cross-sectional profile of the cable trench in agricultural land is shown in **Figure 17**.

Figure 17 Schematic of the Cable Trench

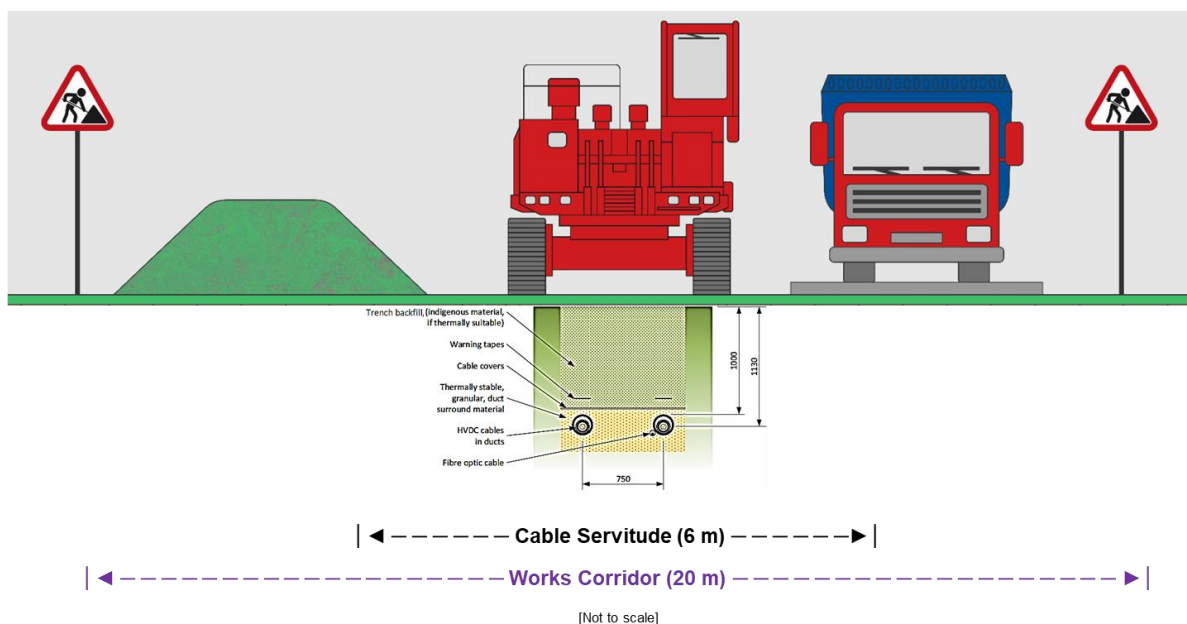

A layer of sand will be placed in the bottom of the trench to reduce thermal stress when the cables are operating. A specific protection layer will be placed above each cable, along with warning notices indicating the presence of the cables. When the work is finished, the natural ground will be reinstated with the same topography as before the works.

The underground cable connects into the converter station. The converter station converts direct current to alternating current and vice versa, before linking it to the French grid. Most of the electrical equipment is installed in buildings. The maximum building height is 25 m and outdoor equipment may be up to 15 m high. In total, the converter station will cover a site of approximately 4 hectares. Buildings, outdoor equipment and landscaping will be surrounded by a perimeter security fence.

The layout and design of the converter station are shown in **Figure 18** and **Figure 19**.

An example of the appearance of a converter station is provided in **Figure 20**.


Figure 18 Layout of the Converter Station in the Zone des Grandes Industries in Dunkerque



Figure 19 Design of the Converter Station in Dunkerque



Figure 20 Example of Converter Station Design
(source: Siemens Aktiengesellschaft)

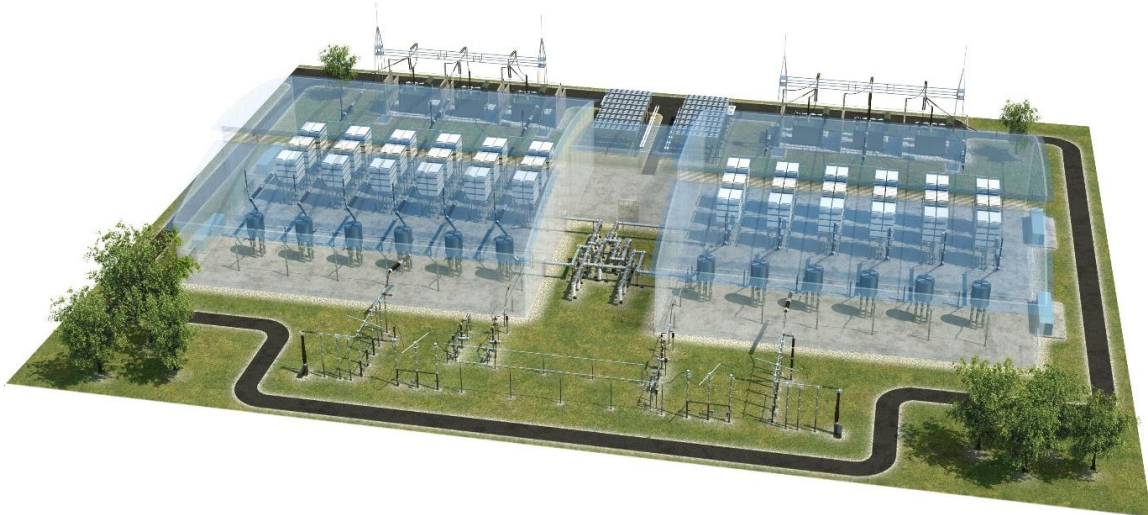

In operation, the station is managed from a control room, which may be installed on site or elsewhere. A small number of operators will also be present on-site to carry out inspection, maintenance and safety checks.

The safety of the station is monitored continuously from the control room to ensure the operations proceed correctly and reliably, and to allow a fast response if any unforeseen incident or emergency should occur.


There are no heat generation, combustion or electricity production activities at the converter station.

The connection point to the French national electricity grid is defined by RTE as the converter station site. However, the connection requires creation of a double-circuit, 400 kV alternating current link laid underground from the GridLink converter station to the Warande 400 kV sub-station.

The route for the underground cable is currently being studied to determine the optimum alignment that minimised environmental effects. Each circuit will consist of three conductor cables, each cable providing one of the three phases of an electrical circuit. The enamelled copper wire cables will have a cross-section of 2,500 mm². They will be laid in HDPE (high-density polyethylene) ducts coated in concrete. Each circuit will be laid in a trench approximately 2 m deep and 1 m wide. The double circuit will have a nominal total width of 5 m and up to 15 to 20 m depending on the nature of the soil. A warning layer will be placed above the circuits to indicate the presence of the cables.

The indicative cross-sectional profile of the cable trench is shown in **Figure 21**.


Figure 21 Schematic of Underground Double-circuit HVAC Cable Layout in Dunkerque
(source: RTE)

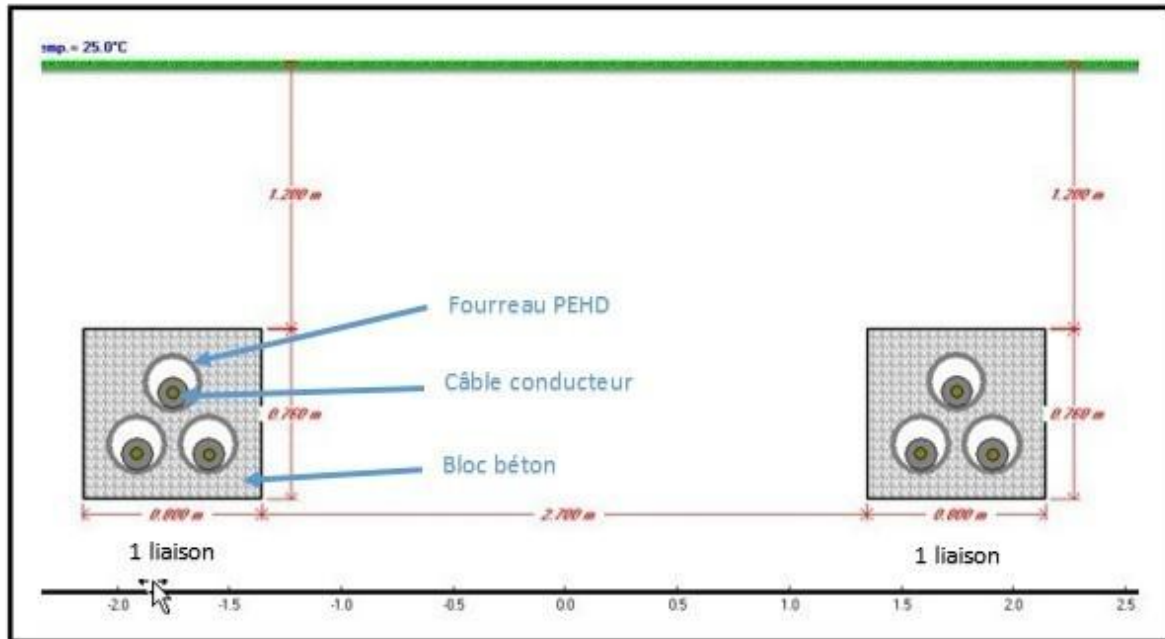

A new substation next to the existing Warande sub-station is required for the installation of the equipment needed for the connection to the national grid. The new substation will be constructed on the south-eastern side of the current substation with an additional surface area of approximately 6.5 ha. The new substation will comprise two busbar sets, two feeder bays for the GridLink connection, and the bays needed for a looped intake of the two existing 400 kV overhead lines for Warande-Avelin and Warande-Weppes.

The location of the new sub-station is shown in **Figure 22**.

Figure 22 Location of the new RTE 400 kV Sub-station in Dunkerque

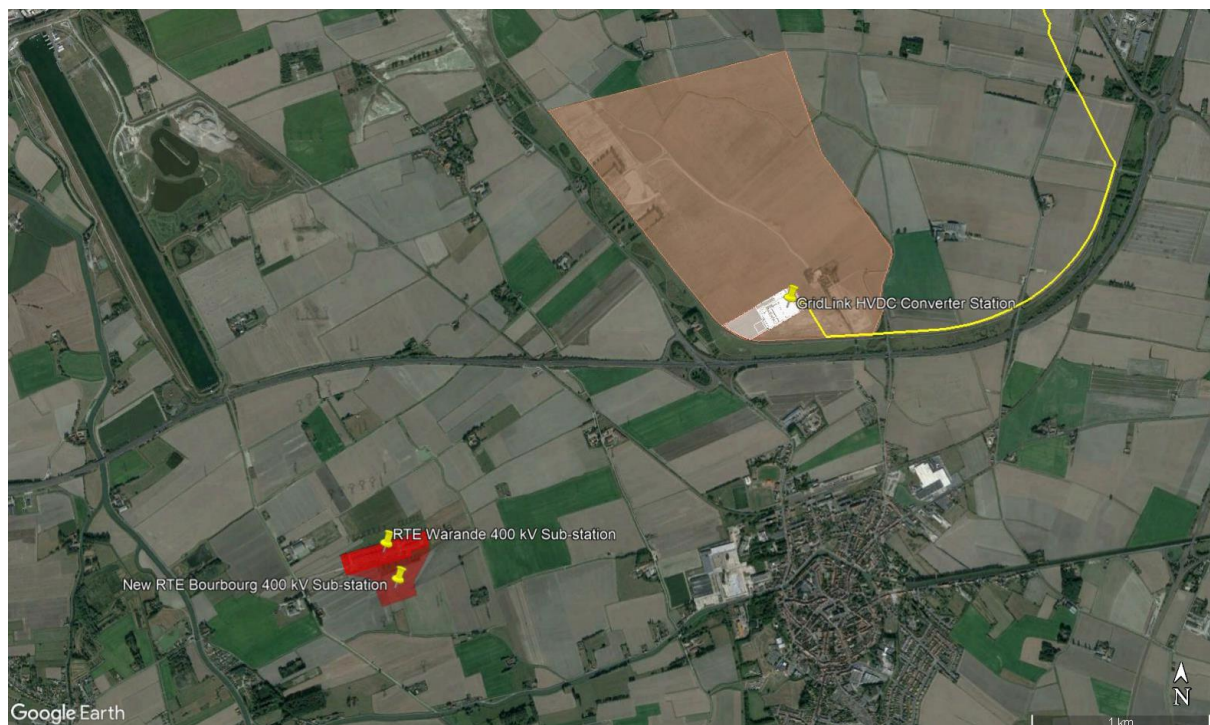

4.6 UNDERGROUND CABLES AND CONVERTER STATION IN UK

The shore crossing in the UK applies the same principles and construction methodologies planned for Dunkerque.

The coastline at Kingsnorth in the Medway Estuary will be crossed by horizontal directional drilling (HDD). This entails the drilling of two horizontal shafts that run beneath the intertidal mud-flats and sea defence bund/wall. The cables are then pulled through each shaft. The choice of this directional drilling technique ensures that there is no surface disturbance thus avoiding any impact on existing natural habitats or the integrity of the flood defences.

The drilling will follow an elliptical trajectory at an angle of about 8 to 12°, passing beneath the coastline and emerging after the low water mark. Ducts will then be installed. When the subsea cable arrives, the individual cables will be pulled separately from the sea through the ducts. Once they emerge from the ducts, the cables will be modified to remove the marine protection, thus reducing their size and weight, and increasing their flexibility necessary for the onshore cable installation.

The converter station site is located close to the shoreline, therefore the HDD drilling rig will be installed immediately next to the site. Once the cables emerge from the ducts, they will be directly connected into the converter station.

The HDD at the Kingsnorth shore crossing is shown in **Figure 23**.

The indicative cross-sectional profile of the HDD is shown in **Figure 24**.

Figure 23 Horizontal Directional Drilling (HDD) of Shore Crossing at Kingsnorth


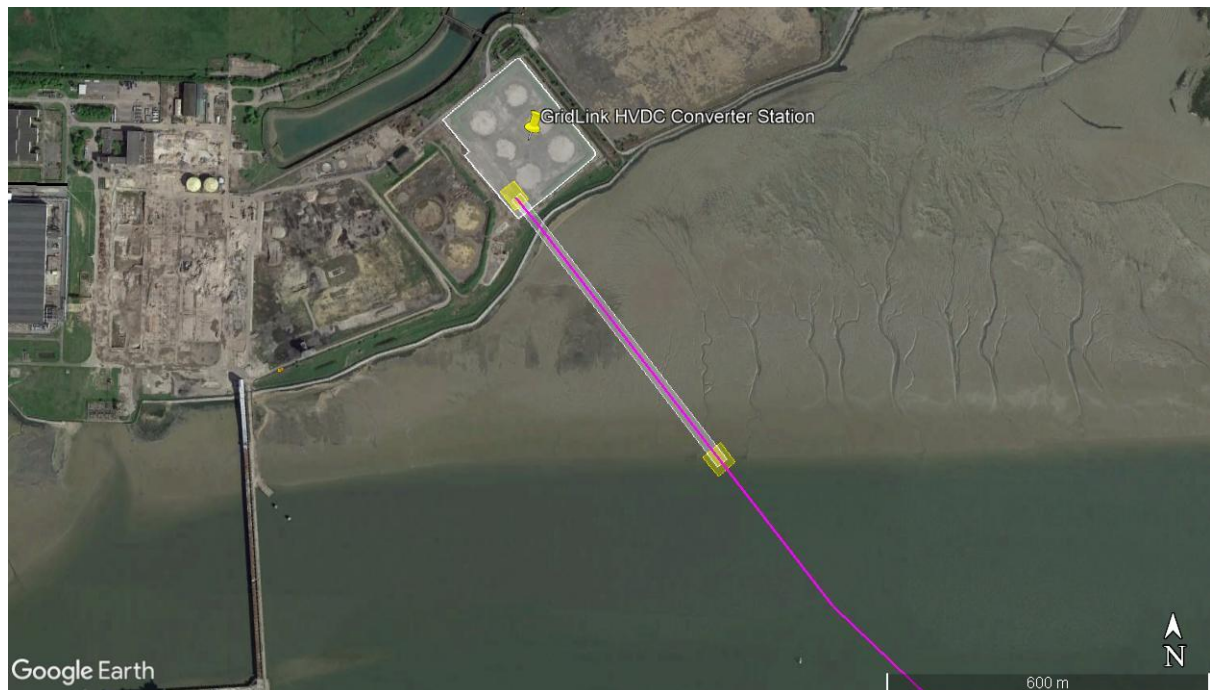


Figure 24 Schematic Cross-section of the Shore Crossing by Horizontal Directional Drilling (not to scale)

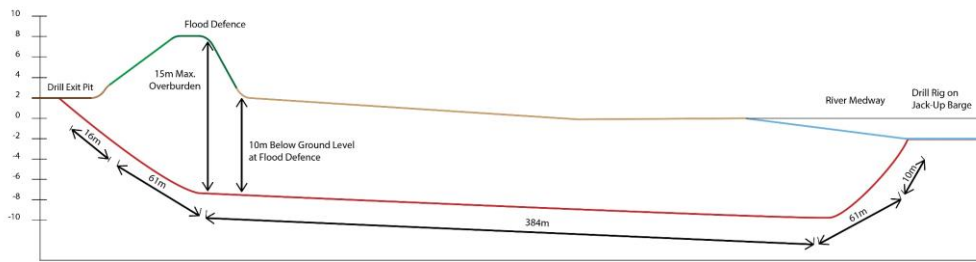

The converter station converts direct current to alternating current and vice versa, before linking it to the UK grid. Most of the electrical equipment is installed in buildings. The maximum building height is 25 m and outdoor equipment may be up to 15 m high. In total, the converter station will cover a site of approximately 4 hectares. Buildings, outdoor equipment and landscaping will be surrounded by a perimeter safety fence.

The converter station site is within the former coal-fired power station site in the Kingsnorth industrial area. The coal-fired power station has been demolished and the land is planned to be used for new industrial development.

The layout and design of the converter station are shown in **Figure 25** and **Figure 26**.

An example of the appearance of a converter station is provided in **Figure 27**.

Figure 25 Layout of the Converter Station at Kingsnorth



Figure 26 Design of the Converter Station at Kingsnorth


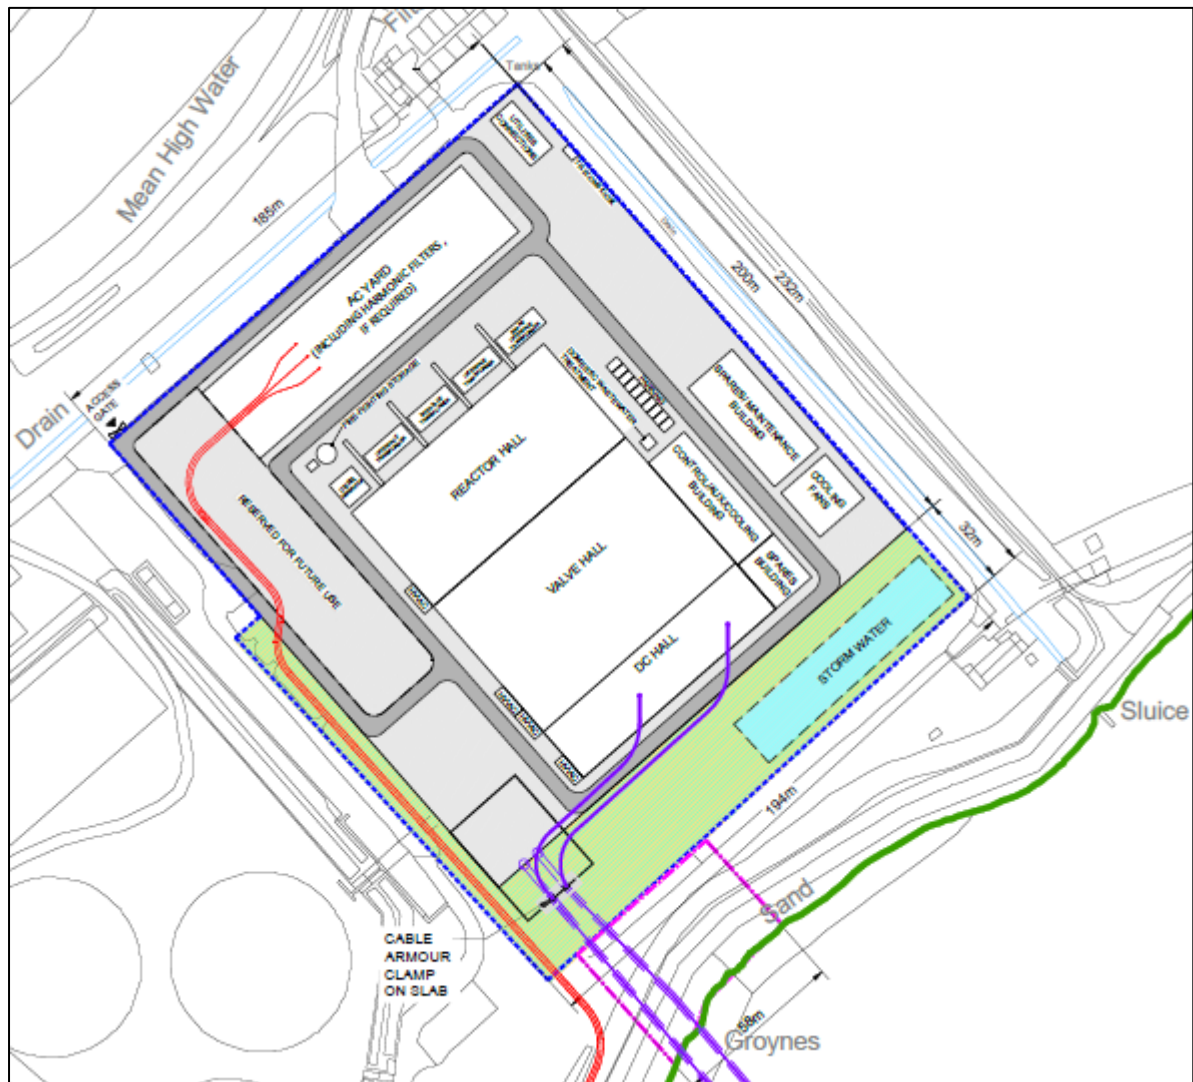


Figure 27 Example of Converter Station Design
(source: Siemens Aktiengesellschaft)

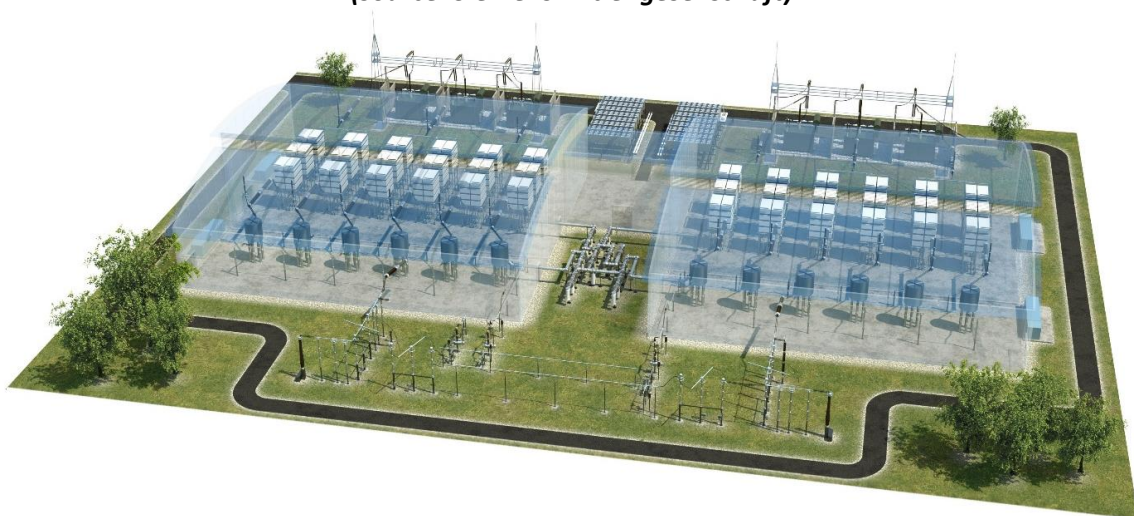

In operation, the converter station is managed from a control room, which may be installed on site or elsewhere. A small number of operators will also be present on-site to carry out inspection, maintenance and safety checks.

The safety of the station is monitored continuously from the control room to ensure the operations proceed correctly and reliably, and to allow a fast response if any unforeseen incident or emergency should occur.

There are no heat generation, combustion or electricity production activities at the converter station.

The connection point to the UK national electricity grid is defined by National Grid at the Kingsnorth 400 kV sub-station. No extension to the sub-station is necessary to accommodate the connection of GridLink.

The connection requires creation of a single-circuit or double-circuit, 400 kV alternating current link laid underground from the GridLink converter station to the Kingsnorth sub-station. The underground cable route is located within the former coal-fired power station site, where the cables will be placed primarily under site roads and footpaths or in a designated services corridor to reach the sub-station.

The converter station, underground cable route and connection point at the sub-station are shown in **Figure 28**.

Figure 28 Location of the Converter Station, Underground Cable and Kingsnorth 400 kV Sub-station




The cable connection to the National Grid Kingsnorth 400 kV sub-station may comprise one or two circuits. Each circuit will consist of three conductor cables, each cable providing one of the three phases of an electrical circuit. The enamelled copper wire cables will have a cross-section of 1,800 to 3,500 mm², depending on the number of circuits. The cables may be laid in high-density

polyethylene (HDPE) ducts. The circuit(s) will be laid in a trench approximately 1.5 m deep and 2 m wide. A protective layer of concrete blocks and a warning layer will be placed above the circuits to indicate the presence of the cables.

A schematic of the underground cable trench is illustrated in **Figure 29**.

Figure 29 Schematic of Underground HVAC Cable in Kingsnorth

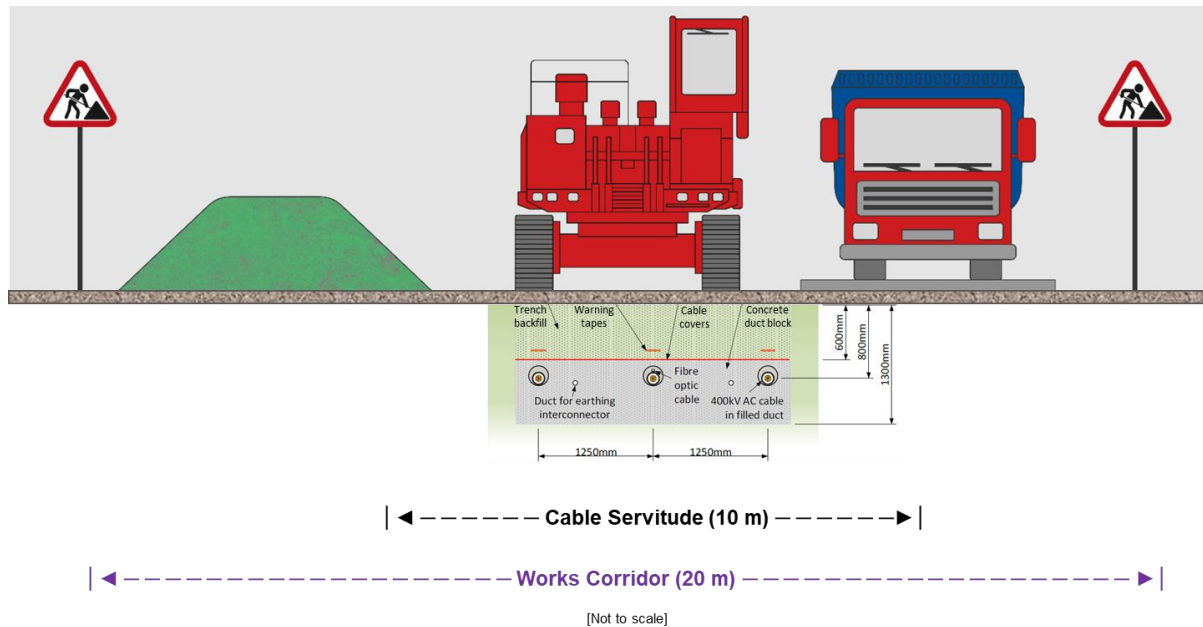

5. ENVIRONMENTAL IMPACTS

5.1 POTENTIAL ENVIRONMENTAL IMPACTS

The key characteristics of the project with respect to the environmental impacts are:

- a) The subsea cable will be buried in the seabed, therefore a narrow section of the seabed approximately 10 m wide will be disturbed by the cable installation along the whole length of the cable route. After cable installation, the seabed will be reinstated and/or naturally restore to its previous condition.
- b) Where the subsea cable crosses other buried cables (three power cables and five telecommunications cables), the cable will be laid on the seabed and covered by rock placement and/or concrete mattresses to protect the cable from anchors and fishing nets. The rock placement/mattresses will be a permanent feature on the seabed, although sedimentation processes will provide a cover of sediment or sand.
- c) At the shore crossings in the UK and France, the subsea cable traverses protected environmental sites and a sea defence wall or ship canal. The cables are installed at the shore crossings using horizontal directional drilling below the sensitive features, such that the land surface is not disturbed.
- d) The onshore cables will be buried underground, therefore a narrow section of land approximately 20 m wide will be disturbed by the cable trench and temporary construction works along the whole length of the onshore cable routes. After cable installation, the temporary construction areas will be reinstated and trench excavations will be backfilled with the topsoil replaced so that the land can be returned to its previous use. In particular, agricultural production can be continued over the cables after installation in France. The permanent restriction in future development activities is limited to 6 m width above the installed cables.
- e) During operation, the transport of electricity through the cables may result in a heating effect and electro-magnetic fields (EMF) in close proximity to the cables. However, due to the design of the cable system, such effects are very small and limited to the immediate area around the cable so there is no significant effect at the seabed or ground surface.
- f) The converter station sites will permanently use approximately 4.4 ha and 6.2 ha of industrial land in the UK and France respectively. The land is zoned for industrial use within a former power station (now demolished) in the UK and designated Zone des Grandes Industries (ZGI) in France. In both cases, the converter station sites are located in compatible industrial areas over 1 km from urban developments.
- g) The converter stations contain electrical equipment for the transformation of the voltage level and type of current of the electricity that is transported by the interconnector. There is no power generation, combustion of fuel or chemical processes at the converter stations, except for an emergency diesel generator in case of failure of the local power network. Therefore, converter stations have negligible emissions to air, low noise production, low water consumption/wastewater discharge, low traffic generation and do not have any major accident hazards.

- h) The project is transboundary in that infrastructure is installed in the UK and France, but the only cross-border impacts that may occur are localised effects from cable installation across the boundary between the territorial waters of the UK and France. Any cross-border impacts will be caused by cable installation vessels during marine operations or sediment mobilisation in the water column. Such impacts will not be significant.

Therefore, the main potential subsea environmental effects are:

- During subsea cable installation:
 - Disruption to shipping and navigation;
 - Disruption to fishing;
 - Disturbance of protected species or designated features of protected sites by marine operations, underwater noise and/or lighting;
 - Suspended solids in the water column and changes to siltation patterns;
 - Damage to marine archaeological heritage and wrecks.
- After subsea cable installation:
 - Scour caused by changes to seabed conditions;
 - Snagging hazards for anchors and fishing gear.

The main potential onshore environmental effects are:

- During construction works:
 - Temporary disturbance of land by construction vehicles and workers;
 - Construction traffic generation;
 - Construction noise;
 - Disturbance to, or pollution of, watergangs (in France only);
 - Disturbance of protected species by construction activities, traffic, noise and/or lighting.
- During operations:
 - Operational noise;
 - Visual and landscape impact from converter station buildings;
 - Loss of agricultural production after trench reinstatement.

GridLink will apply the hierarchy to avoid, when possible, any negative environmental effects, reduce negative effects that cannot be avoided and, as a last resort, compensate for any residual effects. Therefore, a range of mitigation measures have been incorporated into the planning, design and construction works in accordance with this principle.

These mitigation measures include:

- Cable routing that avoids or minimises the section required within sensitive environmental features and protected sites;
- Design of cable crossings to minimise the requirement for rock placement and risk of scour;
- Selection of cable installation methods and seabed intervention measures that minimise the effects on the seabed and suspension of sediment in the water column, for example prohibition of mass flow excavation in sensitive areas;

- Horizontal directional drilling (HDD) to install cables below sensitive environmental features at the surface, including at shore crossings, road/rail/canal crossings and major watergang crossings;
- Incorporation of a range of good international industry practices into construction activities, including for noise control, site lighting, traffic management, temporary construction laydown, soil storage, control of hazardous substances and waste management;
- Defining high standards of architectural design and landscaping, including colour and finish of buildings compatible with the surrounding environment;
- Monitoring of the environment, including before and after cable installation/construction works, to identify any changes caused by implementation of the project;
- Chance find procedures in case of discovery of archaeological heritage, wrecks or Unexploded Ordnance (UXO);
- Fishing liaison and engagement with navigation authorities, environmental authorities and interest groups at an early stage and throughout construction to ensure good communications with stakeholders are maintained.

The incorporation of these mitigation measures at the design stage of the project means that no significant environmental effects are expected during construction or operations.

5.2 PROTECTED ENVIRONMENTAL SITES

The converter station site and onshore cable route in France and the UK are not within 10 km of any terrestrial sites designated for European importance to nature conservation.

The subsea cable route crosses the Medway Estuary, Thames Estuary and southern North Sea. The cable route crosses a Special Protection Area (SPA) and a site of Special Conservation Interest (SCI) in French territorial waters, and two SPAs and two SACs and a wetland of international importance designated under the Ramsar Convention (RAMSAR) site in UK territorial waters. Two of these sites are also designated as Sites of Special Scientific Interest (SSSI) under UK legislation. In addition, the subsea cable route crosses three Marine Conservation Zones (MCZ) designated in the UK.

A summary of the designated areas crossed by or within 10 km of the cable route is provided in **Table 2**. Maps of the designated areas crossed by or within 10 km of the subsea cable route are presented in **Figure 30** (France) and **Figure 31** (UK).

Table 2 NATURA 2000 sites and MCZs within 10 km of the Subsea Cable Route in UK and France

Country	Site	Designation	Distance from Cable Route
FR	Bancs de Flandres	SPA / SCI	Intersects for 31 km
FR	Platier d'Oye	SPA	9 km
UK	Medway Estuary and Marshes	SPA Ramsar SSSI	Intersects for 450 m by directional drilling
UK	Thames Estuary and Marshes	SPA Ramsar SSSI	200 m
UK	Benfleet and Southend Marshes	SPA Ramsar	3 km

Country	Site	Designation	Distance from Cable Route
UK	The Swale	SPA Ramsar	9 km
UK	Foulness (mid-Essex Coast Phase 5)	SPA Ramsar	3 km
UK	Thanet Coast and Sandwich Bay	SPA Ramsar	15 km 19 km
UK	Southern North Sea	cSAC	Intersects for 21 km
UK	Thanet Coast	SAC	3 km
UK	Essex Estuaries	SAC	3 km
UK	Margate and Long Sands	SAC	Intersects for 21 km
UK	Outer Thames Estuary	SPA	Intersects for 49 km
UK	Medway Estuary	MCZ	Intersects 12 km
UK	The Swale Estuary	MCZ	1.5 km
UK	Thanet Coast	MCZ	1.5 km
UK	Goodwin Sands	MCZ	Intersects for 9.5 km
UK	Offshore Foreland	MCZ	Intersects for 5 km
UK	Thames Estuary	MCZ	4.5 km

Figure 30 NATURA 2000 sites and MCZs within 10 km of the Subsea Cable Route in France


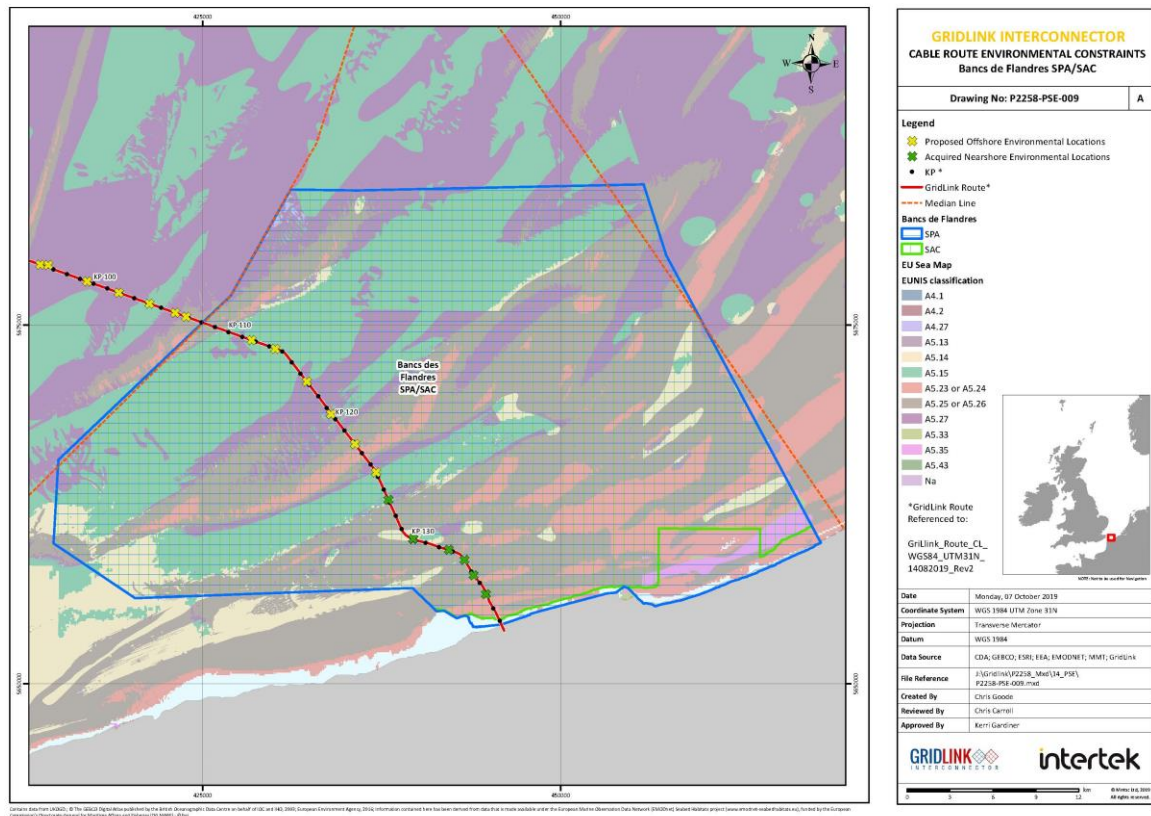


Figure 31 NATURA 2000 sites and MCZs within 10 km of the Subsea Cable Route in UK

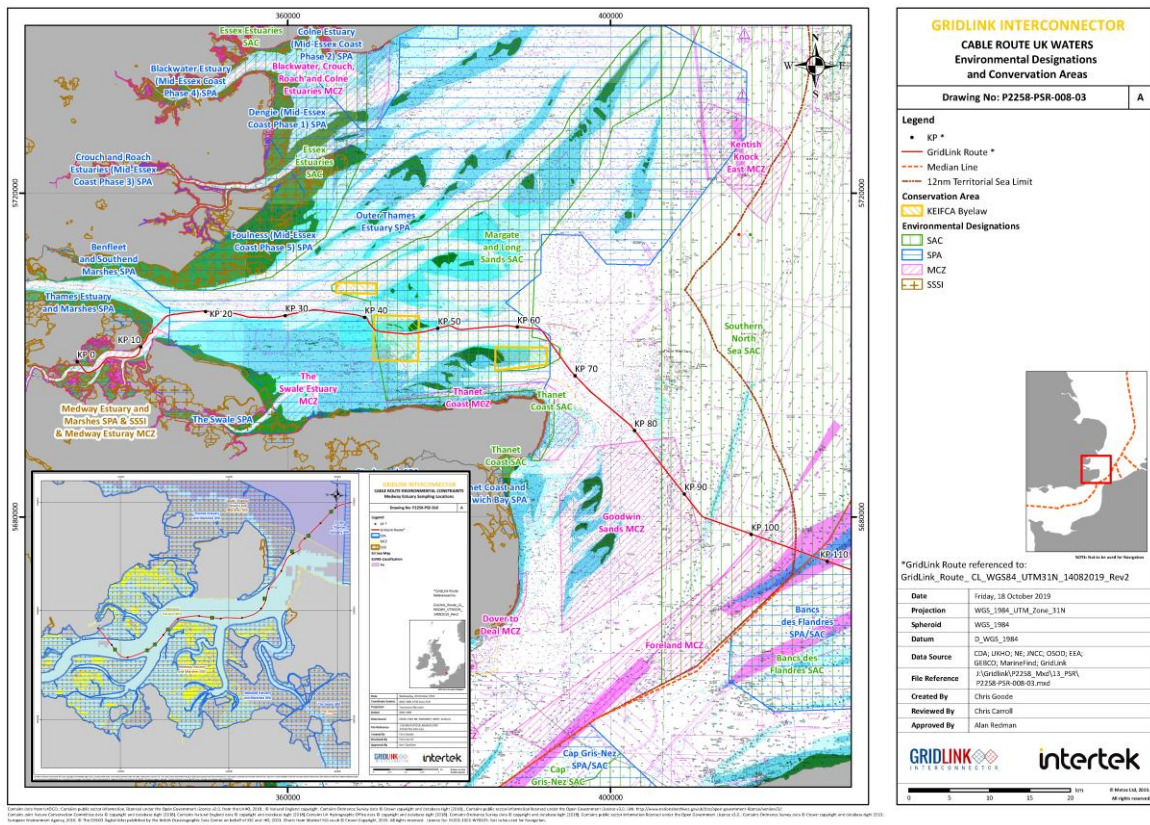

GridLink has commissioned a screening assessment of the potential impacts on NATURA 2000 sites in accordance with the Habitats Directive and Birds Directive (known as a 'Habitats Regulations Appraisal screening assessment'). The assessment will determine whether GridLink is likely to have a significant effect on a European site of nature conservation interest (either alone or in combination with other plans or projects) and, as a result, require an Appropriate Assessment. The assessment will consider effects of construction and operation of the project, including ancillary works such as Unexploded Ordnance (UXO) clearance or temporary construction work sites, relating to noise and visual disturbance, seabed disturbance, suspension of sediment and subsequent deposition, water pollution and, for birds, air quality and lighting. An Appropriate Assessment will be carried out as part of the environmental impact assessment process wherever the potential for adverse effects on qualifying features of NATURA 2000 sites are identified.

6. ENVIRONMENTAL IMPACT ASSESSMENT

6.1 EIA PROCEDURES IN FRANCE

Article R122-2 of the Environmental Code defines the different types of project and their characteristics according to which an Environmental Impact Assessment (EIA) may be required.

Projects may be categorised into one of three groups:

- Project that does not require an EIA;
- “Cas par cas” procedure, consisting of requesting an independent environmental authority (*Autorité Environnementale*) whether the project needs an EIA (a screening opinion);
- Project that requires an EIA.

For the GridLink project, the project categories shown in **Table 3** are relevant.

Table 3 Project Categories for EIA Requirement relevant to GridLink Project in France

Project Category	Projects requiring an EIA	“Cas par Cas” Procedure	Applicability to GridLink Project
32. High voltage electricity transport and distribution facilities	Overhead power lines: Voltage >225 kV and Length >15 km	Overhead power lines: Voltage >225 kV and Length <15 km	Not applicable
		Overhead power lines: Voltage >50 kV	Not applicable
		Electricity sub-station: Voltage >63 kV	“Cas par Cas” procedure required for converter station
33. Underwater high voltage electricity transport cables	Underwater high voltage electricity cable construction		EIA required for subsea cable

According to the Environmental Code, the GridLink project must be treated as a whole, so it cannot be divided between the offshore cable, onshore cable and the converter station. Therefore, although part of the project is covered by the “cas par cas” procedure, the EIA is required to consider the impacts of the complete project, including an overview of the whole project environmental impacts in France and the UK.

The Environment Code states that the EIA must be commensurate with the environmental issues and the potential impacts that the project may cause, and respect the “ERC” principles of:

1. Avoid, when possible, the negative effects of the project;
2. Reduce the negative effects that cannot be avoided;
3. As a last recourse, compensate for any residual effects.

A prior consultation (concertation préalable) procedure is mandatory to define the ongoing consultation requirements during the preparation of the EIA. Finally, the application file will be submitted to a public inquiry (enquête publique).

The mandatory EIA will include the Appropriate Assessment of any potentially significant impacts on NATURA 2000 sites and, if required, an Espoo convention procedure to evaluate the transboundary impacts of the project.

6.2 EIA PROCEDURES IN UK

The construction of the converter station is considered a building operation under the *Town and Country Planning Act 1990*, therefore it requires the granting of planning permission from the Local Planning Authority (Medway Council).

The *Town and Country Planning (Environmental Impact Assessment) (England) Regulations 2017*, as amended, define the requirement for an EIA to support any application for planning permission based on whether the project falls within a category listed in Schedule 1 or 2 of the Regulations:

- If the project falls with a category listed in Schedule 1 of the Regulations then an EIA is mandatory;
- If a project falls within a category listed in Schedule 2 and exceeds the threshold or is situated in a sensitive area, then the Local Planning Authority will determine whether the project is likely to have a significant effect on the environment (taking account of the selection criteria defined in Schedule 3) and therefore an EIA is required (“screening”).

The converter station and onshore underground cable are not listed in Schedule 1 of the Regulations and therefore an EIA is not mandatory. The categories listed in Schedule 2 do not directly reflect the project.

Therefore, the requirement for an EIA has been determined by a request for a screening opinion from Medway Council under the *Town and Country Planning (Environmental Impact Assessment) (England) Regulations 2017*. The screening opinion from Medway Council has determined that an EIA is not required, and instead it has specified the scope of environmental studies that are required to support the planning application.

In addition, the installation of the subsea cable within 12 nautical miles (22 km) requires a Marine Licence under the *Marine and Coastal Access Act 2009* from the Marine Management Organisation (MMO). The *Marine Works (Environmental Impact Assessment) Regulations 2007*, as amended, define the requirement for an EIA to support any marine licence application based on whether the project falls within a category listed in Schedule A1 or A2 of the Regulations:

- If the project falls within a category listed in Schedule A1 then an EIA is mandatory;
- If the project falls within a category listed in Schedule A2 or is situated in a sensitive area, then the MMO will determine whether the project is likely to have a significant effect on the environment and therefore an EIA is required (“screening”).

The installation of subsea cables is not listed in Schedule A1 and A2, therefore an EIA is not mandatory. However, as the subsea cable route crosses a number of NATURA 2000 sites and Marine Conservation Zones, GridLink has requested a screening opinion from MMO to determine if an EIA is required in accordance with the *Marine Works (Environmental Impact Assessment) Regulations 2007*. The screening opinion from MMO has determined that an EIA is not required, although the provision of environmental information remains an official part of the license

application file. GridLink has consulted with MMO on the required scope of this environmental information.

Stakeholder consultations will be carried out during the preparation of the environmental reports/EIAs as well as related to the applications for planning permission and Marine Licence.

The environmental report for the Marine Licence will include the Appropriate Assessment of any potentially significant impacts on NATURA 2000 sites and, if required, an Espoo convention procedure to evaluate the transboundary impacts of the project.

7. PUBLIC CONSULTATIONS

7.1 PUBLIC CONSULTATIONS IN FRANCE

A preliminary consultation was organized by GridLink Interconnector Ltd and RTE, in accordance with Article L121-16 of the Environment Code.

The whole project, comprising all marine and terrestrial works including those connecting the GridLink converter station to the new Warande sub-station under RTE, has been covered by this prior consultation.

Under the supervision of the Commission Nationale du Débat Public (CNDP) guarantor, appointed on 24 July 2017, the project owners conducted a preliminary consultation with the general public and key stakeholders who may have a particular interest in the GridLink project. These stakeholders are interested parties both in the installation of offshore cables on the seabed and in the terrestrial parts of the project. The preliminary consultation included professional fishermen, environmental associations, representatives of agriculture and the development council of the Grand Port Maritime of Dunkirk.

The planning of the preliminary consultation was set with the aim of involving the population in parallel with the public debate of the Grand Port Maritime of Dunkerque concerning its CAP 2020 project; this was to ensure that the public receives information about the GridLink project in the context of the future overall development of the area, with the CAP 2020 public debate taking place from 18 September to 22 December 2017. Therefore, the prior consultation was organized between 27 November 2017 and 12 January 2018.

The preliminary consultation included the following information and participation methods:

- Establishment of information points and publications in local newspapers in early December 2017 to inform the public about the planned public meetings;
- Information points providing flyers on public meetings, brochures on the project and copies of the consultation dossier (5 points of information in the town halls of Dunkerque, Loon Plage, Craywick, Bourbourg and Mardyck);
- Organization of open public meetings (two meetings, one each in Loon-Plage and Bourbourg);
- Organization of thematic round tables by invitation (five round tables);
- Establishment of a dedicated telephone line (hotline);
- Creation of an Internet site (www.gridlinkinterconnector.com) for the electronic sharing of documents, the downloading of information, the possibility of asking a question and giving an opinion, and the giving the e-mail contacts with the project owner.

A summary of the prior consultation activities is presented in **Table 4**.

Table 4 Preliminary Public Consultation Activities in France

Activity	Number	Location	Date
Information points	5	Loon-Plage Bourbourg Craywick Dunkerque Mardyck	27.11.2017 to 12.01.2018
Notices in local newspapers	2	Le Phare La Voix du Nord	01.12.2017 05.12.2017
Public meetings	2	Loon-Plage Bourbourg	07.12.2017 10.01.2018
Thematic meetings	5	Conseil de Développement du GPMD Association de protection de l'environnement (ADELFA) Représentants du monde agricole Représentants de la pêche professionnelle Association de protection de l'environnement (Virage-Energie)	07.12.2017 13.12.2017 19.12.2017 19.12.2017 10.01.2018
Written contributions	3	ADELFA M. Nicolet Virage-Energie	03.01.2018 11.01.2018 12.01.2018
Web-site use	239 1,692 373	Unique visitors Number of pages consulted Document downloads	27.11.2017 to 12.01.2018
Web-site contact questions	5	Michel Mariette, ADELFA	22.12.2017
Telephone hotline	1	Actinium Dunkerque	12.01.2018
Newspaper articles	1 1	Le Phare Nouvelles du Web: Le Phare	27.12.2017

The dossier des enseignement was published by GridLink on its web-site on 29th March 2018. It provides an overview of the commitments by GridLink to ongoing stakeholder engagement and public consultations. These include further public meetings and thematic meetings at the start of the main EIA procedures, when the preliminary EIA results are available and prior to submission of the application files for development consent.

GridLink is currently implementing the recommendations of the dossier des enseignements. The activities and calendar for the ongoing public consultations are described in the Concept for Public Participation prepared for the project.

7.2 PUBLIC CONSULTATIONS IN UK

There is no official procedure for public consultation in the UK.

Preliminary stakeholder engagement activities comprised an environmental scoping workshop with competent authorities at the start of the development phase, establishment of a web-site for public information and questions, consultation meetings with Medway Council, including the planning authority and elected members, consultations meetings with maritime stakeholders, including navigation authorities, fishing associations and offshore windfarm and cable owners, and wider consultations with environmental interest groups to inform the environmental studies being carried out.

The key consultation activities include:

- Environmental scoping workshop in February 2017;
- Web-site launch in November 2017;
- Appointment of a Fishing Liaison Officer and start of consultations with fishermen associations in September 2018;
- Members Briefing with Medway Council in February 2019;
- Consultation meetings with navigation authorities, fishing associations and offshore windfarm and cable owners to facilitate the marine survey in April-June 2019;
- Members Briefing with Medway Council in October 2019;
- Notification of wide range of stakeholders to inform the environmental studies in November-December 2019;
- Ongoing communication and liaison with Peel Ports and Port of London Authority, Medway Council, Marine Management Organisation (MMO) and Natural England.

GridLink is currently implementing additional stakeholder engagement to build upon the preliminary consultations. The activities and calendar for the ongoing public consultations are described in the Concept for Public Participation prepared for the project.

7.3 WEB-SITE

GridLink Interconnector Ltd established a web-site in November 2017.

The web-site address is: www.gridlinkinterconnector.com.

The web-site contains information about the project in dual language of English and French.


The web-site includes:

- General planning of the project;
- Documents prepared as part of the Project of Common Interest (PCI) status:
 - Information brochure;
 - Non-technical summary of the project;
 - Public consultation schedule, indicating the dates and places of the public events and the subjects evoked during the events;
 - Contact information for obtaining complete files of applications for administrative authorizations;
 - Contact information to make comments or complaints in the context of the consultations;
 - Link to the European Commission website.
- Summary of the consultation mechanisms used in France and UK;
- Technical studies to be downloaded – if they are completed and not confidential;
- Documents to be downloaded and links to related information;
- Integrated link to / from the RTE website.

GridLink is committed to answering all questions that are received via the website. Unless the person concerned objects, any questions and their answers will be published on the website within a target period of 14 days.

The web-site home-page menu tabs are shown in **Figure 32**.

Figure 32 GridLink Web-site Menu Tabs

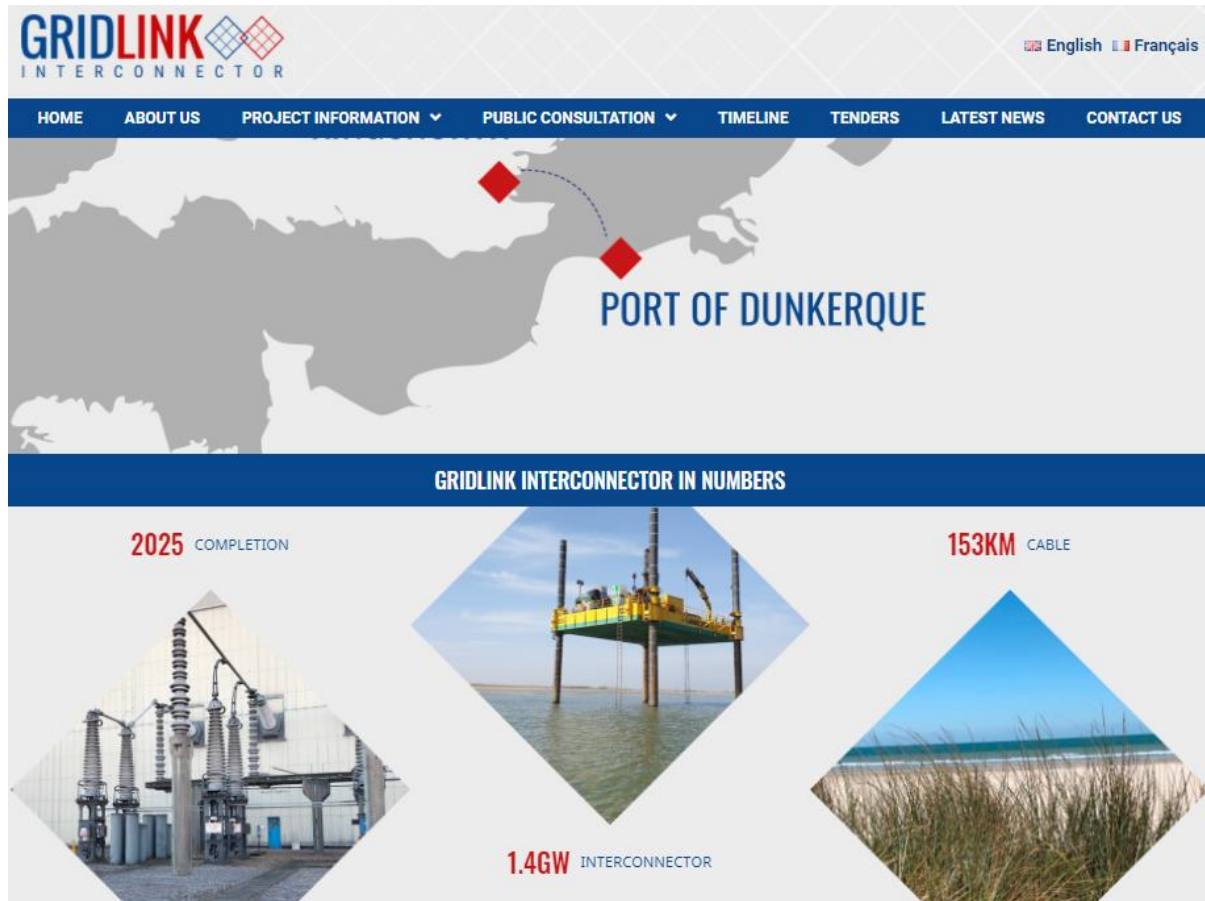

7.4 CONCEPT FOR PUBLIC PARTICIPATION

GridLink Interconnector Ltd intends to positively engage with the general public, local communities, local businesses and all statutory and non-statutory stakeholders in relation to the development, construction and operation of the GridLink project.

GridLink will engage with relevant stakeholders to ensure that accurate information related to the project is disseminated and the opportunity is provided for stakeholders to provide opinions, submit requests or make complaints and grievances.

GridLink has prepared a Concept for Public Participation (with a supporting Calendar of Public Consultation Events) to document the planned public consultation activities and inform stakeholders about sources of information and opportunities to participate. The Concept for Public Participation is published on the GridLink web-site or available on request.

In France, the public participation is supervised by the guarantor appointed by the Commission Nationale du Débat Public (CNDP).

8. FURTHER INFORMATION

Further information on the GridLink project can be found at:

www.gridlinkinterconnector.com